




County of San Diego, Planning & Development Services  
**SAMPLE PLACARD FOR ALTERNATE POWER SOURCE**  
**BUILDING DIVISION**

This is a sample placard required when there is an alternate source of power connected to the premises wiring system. Specify the type of generation, such as stationary engine generator, solar photovoltaic (PV) array, wind turbine, batteries, fuel cell, etc. The placard must be metal or plastic, with engraved or machine printed letters in a contrasting color, and must include the location of the service point, utility meter, AC and DC disconnects, inverter, and PV array, generator, or other type of generation source, and a footprint of the entire building and site. The placard shall be attached to the service disconnect with pop-rivets, machine screws, or other fasteners as approved by the County of San Diego, Building Division. Epoxy is not an acceptable method of securing the placard.

**CAUTION**

3/4"

**POWER TO THIS BUILDING IS ALSO SUPPLIED FROM THE FOLLOWING SOURCES WITH DISCONNECTS LOCATED AS SHOWN:**

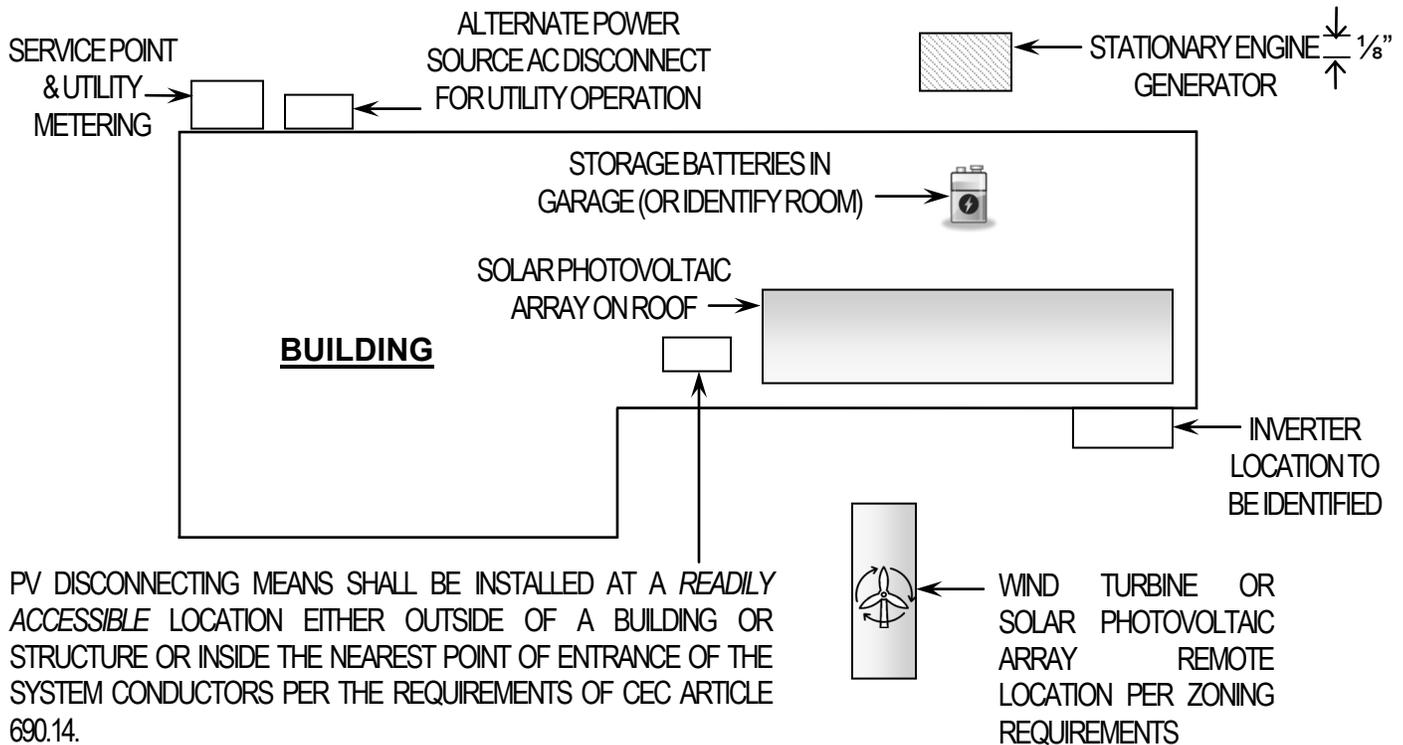

PV DISCONNECTING MEANS SHALL BE INSTALLED AT A READILY ACCESSIBLE LOCATION EITHER OUTSIDE OF A BUILDING OR STRUCTURE OR INSIDE THE NEAREST POINT OF ENTRANCE OF THE SYSTEM CONDUCTORS PER THE REQUIREMENTS OF CEC ARTICLE 690.14.

Acknowledgement: This material is based upon work supported by the Department of Energy under Award Number DE-EE0000902.

Disclaimer: This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.