



**County of San Diego  
Planning & Development Services  
BUILDING DIVISION**

<b>ACCESSIBILITY CORRECTION LIST</b> Public Accommodations & Commercial Buildings	<b>1B</b>
<b>Site Accessibility and Exterior Routes of Travel</b>	

RECORD ID:	OWNER ON APPLICATION:
------------	-----------------------

**SITE ACCESSIBILITY**

- Identify on site accessibility plan location of the following elements as provided and distinguishing between accessible and inaccessible elements and new and existing elements:
  - Buildings and facilities
  - Parking spaces
  - Passenger loading zones
  - Public transportation stops
  - Walks and sidewalks
  - Curb ramps
  - Exterior pedestrian ramps
  - Exterior stairways
  - Exterior drinking fountains
  - Exterior public telephones
  - Elevators or platform lifts serving exterior routes

*CBC 11B-402*
- Identify on site accessibility plan the following accessible routes of travel using ■■■■■■ or equivalent symbol:
  - Between all building exterior ground-floor exits and the public way  
**Exception:** Exterior ground-floor exits serving smoke-proof enclosures, stairwells, and exit doors servicing stairs only  
**Exception:** Exits in excess of number required to be accessible per CBC 1007 and more than 24 inches above grade
  - Between accessible parking spaces and building or facility entrances
  - Between passenger loading zones and building or facility entrances
  - Between public streets or sidewalks and building or facility entrances  
**Exception:** Accessible route not required between site arrival points and building or facility entrance if only means of access between is vehicular way not providing pedestrian access
  - Between public transportation stops and building or facility entrances
  - Between accessible buildings, facilities, elements, and spaces on the same site.  
**Exception:** Accessible route not required between accessible buildings, facilities, elements, and spaces if only means of access between is vehicular way not providing pedestrian access

*CBC 11B-206.2.1 and CBC 11B-206.2.2*
- Accessible routes shall coincide with or be located in the same area as general circulation paths.  

*CBC 11B-206.3*
- Where more than route of travel is provided, all routes shall be accessible.  
**Exception:** General circulation paths shall be permitted when located in close proximity to an accessible route  

*CBC 11B-206.2.1*

**EXTERIOR ROUTES OF TRAVEL**


- Dimension on site accessibility plan minimum 48-inch-wide walks and sidewalks.  
**Exception:** Minimum 36-inch clear width at existing sidewalks with right-of-way restrictions  
**Exception:** Minimum 60-inch clear width at islands or cut-through medians  

*CBC 11B-403.5.1 and CBC 11B-406.6*
- For accessible routes less than 60-inches wide and more than 200-feet long, dimension on site accessibility plan passing spaces minimum 60 inches by 60 inches – or equivalent T-shaped intersections – at maximum 200-foot intervals.  

*CBC 11B-403.5.3*


**THIS DOCUMENT IS FOR PLAN REVIEW ONLY.  
CORRECTION LIST ITEMS AND FIGURES MAY NOT BE REPRODUCED OR COPIED ON PLANS.  
IF CONFLICTS EXIST BETWEEN CODE TEXT AND FIGURES, THE CODE TEXT SHALL GOVERN.**

7. Specify on site accessibility plan running slope of each walk and sidewalk.
8. Specify on site accessibility plan spot elevations at each walk and sidewalk to verify run exceed 5% unless ramp provided per accessibility correction list 4B.  
**Exception:** Running slope of sidewalks shall not exceed the general grade established
9. Specify on site accessibility plan maximum 2.1% cross slope of each accessible route.
10. Specify on site accessibility plan accessible route surfaces of stable, firm, and slip-resis
11. For walks with continuous gradients, dimension on site accessibility plan minimum 5-foot intervals.
12. Identify on site accessibility plan and dimension any abrupt changes in level greater tha
13. For abrupt changes in level between 1/4 inch and 1/2 inch on accessible routes, detail r Figure 11B-303.3.

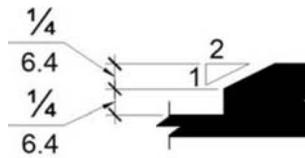

**FIGURE 11B-303.  
BEVELED CHANGE IN**

14. For abrupt changes in level greater than 1/2 inch on accessible routes, provide pedestri  
**Exception:** Changes in level served by curb ramps shall meet requirements of accessil
15. Identify on site accessibility plan any grates or similar openings located on accessible r per CBC Figure 11B-302.3 with any elongated openings placed perpendicular to domin

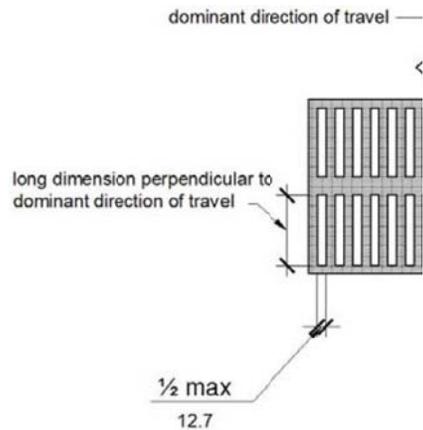

**FIGURE 11B-302.3  
ELONGATED OPENINGS IN FLOOR OR C**