

APPENDIX A

Photograph Log

PHOTOGRAPH LOG

Otay Ranch Village 14 and Planning Areas 16/19



Photograph 1. Existing condition of Proctor Valley Road just east of Agua Vista Drive and Northwoods Drive intersection. Jamul Mountain range is visible in the background.



Photograph 2. View of fuel types and terrain outside of the southern boundary of the Project Area. Arizona crossing borders northern edge of Upper Otay Reservoir.



Photograph 3. Photograph depicts fuel types (short, non-native grasses in foreground; coastal sage scrub-rolling hills; and chamise chaparral-Jamul Mtn. slopes) used for fire scenario #1 adjacent to southern edge of Otay Ranch Village 14.



Photograph 4. SDG&E power line easement traverses from east to west through southern portion of Otay Ranch Village 14.



Photograph 5. Disturbed coastal sage scrub and non-native grasslands are present in designated preserve land adjacent to Village 14.



Photograph 6. View of fuel types in the eastern and central portions of property abutting Village 14 site. Majority of site is Diegan coastal sage scrub and chamise chaparral. Both fuel types were modeled in fire scenario #2.



Photograph 7. Close-up view of chamise chaparral and sage scrub fuel types.



Photograph 8. View of San Miguel Mountain (upper, left-side of photograph) and relatively flat terrain adjacent to southwest edge of Village 14.



Photograph 9. Photograph depicts chamise chaparral fuels at base of mountain range and coastal sage scrub on slopes. These fuel types just west and outside Project Area were modeled for fire scenario #6.



Photograph 10. View of fuel types in the northeastern portion of property. Majority of site is coastal sage scrub with patches of non-native grasslands and chamise shrubs.



Photograph 11. Close-up of view of fuel types described in photograph 10.



Photograph 12. Looking north along Proctor Valley Road towards the community of Jamul. This portion of road will be improved to DPW standards.



Photograph 13. Photograph looking northwest of slopes vegetated with chamise chaparral-sage scrub fuels. This fuel bed was modeled for fire scenario #5.



Photograph 14. Another view of fuel types in the northwestern portion of property. Majority of site is coastal sage scrub with patches of non-native grasslands and chamise shrubs.




Photograph 11. View of grasslands just south of Proctor Valley Road in the northern portion of the Project Area. Photo is looking toward the west.



Photograph 12. Looking south from Proctor Valley Road towards the northern portion of Otay Ranch Planning Areas 16/19. The grass (in foreground) and sage scrub covered hillsides (background) were modeled for fire scenario #4.

APPENDIX B

Fire History Exhibit

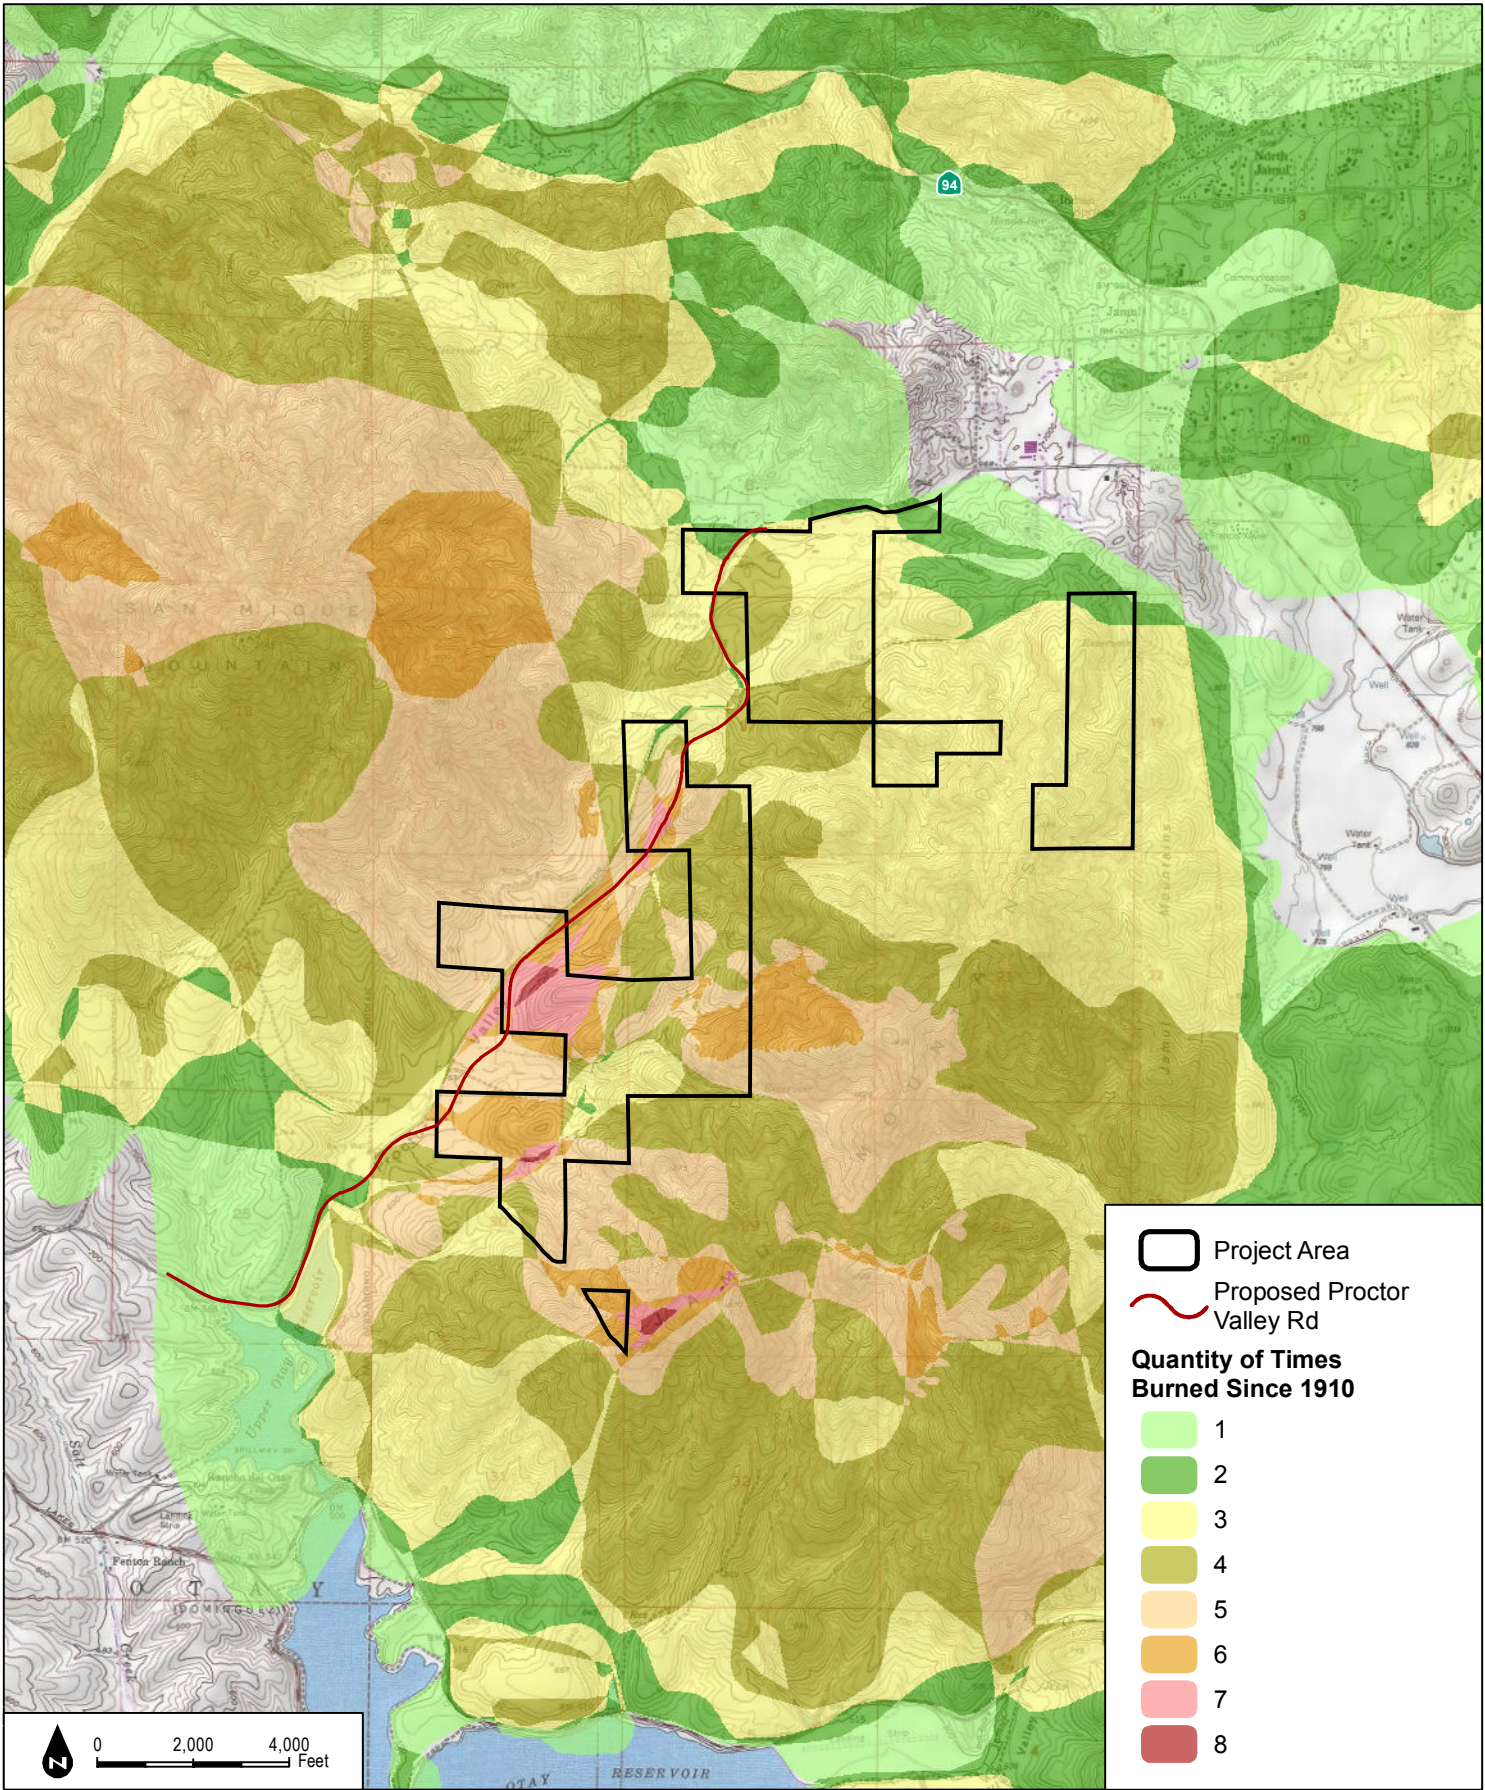

APPENDIX C
Fire Service Availability Form



County of San Diego, Planning & Development Services
PROJECT FACILITY AVAILABILITY - FIRE
ZONING DIVISION

Please type or use pen

GDCI Proctor Valley, LP (619) 267-4904

Owner's Name Phone

2245 San Diego Ave, Suite 223

Owner's Mailing Address Street

San Diego CA 92110

City State Zip

ORG _____

ACCT _____

ACT _____

TASK _____

DATE _____

AMT \$ _____

DISTRICT CASHIER'S USE ONLY

F

SECTION 1. PROJECT DESCRIPTION

TO BE COMPLETED BY APPLICANT

- A. ☒ Major Subdivision (TM) ☒ Specific Plan or Specific Plan Amendment
☐ Minor Subdivision (TPM) ☐ Certificate of Compliance:
☐ Boundary Adjustment
☐ Rezone (Reclassification) from _____ to _____ zone.
☐ Major Use Permit (MUP), purpose: _____
☐ Time Extension...Case No. _____
☐ Expired Map...Case No. _____
☒ Other General Plan Amendments

Assessor's Parcel Number(s)
 (Add extra if necessary)

SEE ATTACHED

- B. ☒ Residential Total number of dwelling units 1,119
☒ Commercial Gross floor area 10,000 square feet
☐ Industrial Gross floor area _____
☐ Other Gross floor area _____

C. Total Project acreage 1283 Total lots 995 Smallest proposed lot .09 acrs

Thomas Guide. Page 1292 Grid C7

12800 Proctor Valley Road, Chula Vista, CA

Project address Street

Jamul Dulzura/Otay Subregion 91914

Community Planning Area/Subregion Zip

OWNER/APPLICANT AGREES TO COMPLETE ALL CONDITIONS REQUIRED BY THE DISTRICT.

Applicant's Signature: [Signature]

Date: 10/20/2016

Address: 2245 San Diego Ave, Suite 223, San Diego, CA 92110

Phone: 619 267-4904

(On completion of above, present to the district that provides fire protection to complete Section 2 and 3 below.)

SECTION 2: FACILITY AVAILABILITY

TO BE COMPLETED BY DISTRICT

District Name: San Diego County Fire Authority

Indicate the location and distance of the primary fire station that will serve the proposed project:

New fire station to be located within the development

- A. ☒ Project is in the District and eligible for service.
☐ Project is not in the District but is within its Sphere of Influence boundary, owner must apply for annexation.
☐ Project is not in the District and not within its Sphere of Influence boundary.
☐ Project is not located entirely within the District and a potential boundary issue exists with the _____ District.
B. ☐ Based on the capacity and capability of the District's existing and planned facilities, fire protection facilities are currently adequate or will be adequate to serve the proposed project. The expected emergency travel time to the proposed project is _____ minutes.
☒ Fire protection facilities are not expected to be adequate to serve the proposed development within the next five years.
C. ☒ District conditions are attached. Number of sheets attached: 3
☐ District will submit conditions at a later date.

SECTION 3. FUELBREAK REQUIREMENTS

Note: The fuelbreak requirements prescribed by the fire district for the proposed project do not authorize any clearing prior to project approval by Planning & Development Services.

- ☒ Within the proposed project 100 feet of clearing will be required around all structures.
☐ The proposed project is located in a hazardous wildland fire area, and additional fuelbreak requirements may apply. Environmental mitigation requirements should be coordinated with the fire district to ensure that these requirements will not pose fire hazards.

This Project Facility Availability Form is valid until final discretionary action is taken pursuant to the application for the proposed project or until it is withdrawn, unless a shorter expiration date is otherwise noted.

Authorized Signature

Print Name and Title

Phone

Date

On completion of Section 2 and 3 by the District, applicant is to submit this form with application to:
 Planning & Development Services - Zoning Counter, 5510 Overland Ave, Suite 110, San Diego, CA 92123



PDS-399F (Rev. 09/21/2012)

**Otay Ranch Proctor Valley Village 14 and Preserve
APNs By Ownership**

Village 14

1. 598-070-09
2. 598-070-07
3. 598-010-02
4. 598-020-04
5. 598-020-06
6. 598-021-02
7. 597-140-05

Planning Areas 16/19

1. 597-020-10
2. 597-140-04
3. 597-020-06
4. 597-190-23
5. 597-150-13
6. 597-150-03
7. 597-150-12
8. 597-150-07
9. 597-150-08



County of San Diego

HERMAN REDDICK
PROGRAM MANAGER
(858) 974-5999
FAX (858) 467-9662

Public Safety Group
San Diego County Fire Authority
5510 Overland Ave, Suite 250, San Diego, CA 92123-1239
www.sdcountyfire.org

SUSAN QUASARANO
PROGRAM COORDINATOR
(858) 974-5924
FAX (858) 467-9662

October 21, 2016

GDCI Proctor Valley, LP
2245 San Diego Ave., Suite 223
San Diego, CA 92110

Ref: **Project Facility Availability Form (399F)**
Multiple APNs
Otay Ranch Villages 14,16,19 – Conditions

Following are the County Fire Marshal's Office comments in response to a request for a Project Facility Availability Form, and are preliminary in nature.

FIRE & EMERGENCY SERVICES - Availability

The density and location of the project will necessitate a new fire station to be provided within the project. The project will be conditioned to provide the funding for the construction, equipping and the ongoing operations and maintenance of the new fire station.

FIRE ACCESS ROADWAYS - Road design

1. Fire access roadways are required from building pads to a public way. The fire access roadway (including driveways) shall be extended to within 150 feet of acceptable fire fighter/hoseline access to all ground level exterior portions of proposed buildings.
2. Proposed on-site roadways will be required to meet DPW Public or Private Road Standards and designed to support the imposed load of fire apparatus (not less than 75,000 lbs.).
3. Due to the density of the project, on street parking shall be provided on both sides of the street to ensure that the minimum clear width of 24 feet is maintained at all times.
4. Cul-de-sacs shall have a paved radius of 42 feet to allow for on street parking within the cul-de-sac.
5. Any gates or other obstructions which could delay or otherwise impede emergency response are prohibited unless approved by the County Fire

Marshal and meet Department of Public Works Design Standards 17, 18 or 19, as well as the County Consolidated Fire Code.

6. Traffic calming devices (including, but not limited to, speed bumps, speed humps, speed control dips, etc.) shall be prohibited unless approved by the County Fire Marshal.
7. A vertical clearance of not less than 13 feet 6 inches shall be maintained.
8. No construction involving combustible materials on the subject property can take place until fire access roads are installed and fully meet code requirements. (Exception: If prearranged with the fire authority having jurisdiction, asphalt paving may be installed with the exception of the final lift, which may be postponed until just before building final if desired for roadway cosmetic purposes.)

FUEL MODIFICATION ZONES

1. The fuel modification zones around development areas shall be designed as to eliminate the presence of pockets, islands and peninsulas of unmanaged, combustible vegetation.
 2. A fuel modification zone of not less than 100-foot is required around all structures, in accordance with the specifications of the County Consolidated Fire Code. Additional clearance may be required after review and acceptance of a fire protection plan (discussed below).
 3. The fuel modification zone must be established and maintained by thinning, clearing away or modifying combustible vegetation within the zone. The fuel modification zone may be re-planted with either approved irrigated, fire-resistant planting material or approved non-irrigated, drought-tolerant, fire-resistant plant material. Re-planting with approved plant material may be required for erosion control.
EXCEPTIONS:
 - a) Single specimens of trees, ornamental shrubbery or similar plants used as ground covers, provided that they do not form a means of rapidly transmitting fire from the native growth to any structure.
 - b) Grass and other vegetation located more than 50 feet from buildings or structures and less than 18 inches in height above the ground need not be removed where necessary to stabilize the soil and prevent erosion.
3. This does not authorize clearing beyond property line.

FIRE PROTECTION – Fire Protection Plan

A Fire Protection Plan, prepared by a PDS-approved consultant, shall be provided and be formatted per the County of San Diego Guidelines for Determining

Significance and Report Format and Content Requirements—Wildland Fire and Fire Protection.

FIRE PROTECTION – Automatic fire sprinklers

All structures shall be equipped with automatic fire sprinklers designed and installed to applicable NFPA and County of San Diego standards.

WATER SUPPLY—Fire hydrants and water mains

1. Fire hydrants shall be installed at intersections, at the beginning radius of cul-de-sacs and every 300 feet of fire apparatus access roadways.
2. The fire flow capacity for the water main serving the hydrants shall be a minimum of 2,500 gallons per minute.
3. Fire hydrants are to be identified by a reflectorized blue marker, with a minimum dimension of 3 inches, in the center of the travel lane adjacent the water source, or by other methods approved by the fire code official.

IGNITION-RESISTIVE CONSTRUCTION (informational only)

At the time of building plan review, the Fire Marshal will check for fire code compliance with the County Consolidated Fire Code, County Building Codes, and other applicable standards. Plans will be reviewed for elements including (but not limited to):

- Class A roofing
- Non-combustible exterior walls
- Dual pane/tempered glazing
- Vent restrictions
- Eaves enclosed, not vented
- Smoke alarms
- Spark arresters
- Deck restrictions

Please call or email me if you have any questions or need clarification – (858) 495-5434 or James.Pine@sdcounty.ca.gov.

Best regards,



James Pine, Deputy Fire Marshal
San Diego County Fire Authority
Public Safety Group

APPENDIX D
Water Service Availability Form



County of San Diego, Planning & Development Services
PROJECT FACILITY AVAILABILITY - WATER
ZONING DIVISION

Please type or use pen

GDCI Proctor Valley, LP	619-267-4904	ORG _____	W
Owner's Name	Phone	ACCT _____	
c/o Jackson Pendo Development Company, 2245 San Diego Ave, Suite 223		ACT _____	
Owner's Mailing Address	Street	TASK _____	
San Diego	CA 92110	DATE _____	
City	State	Zip	AMT \$ _____
DISTRICT CASHIER'S USE ONLY			

SECTION 1. PROJECT DESCRIPTION

TO BE COMPLETED BY APPLICANT

- A. ☒ Major Subdivision (TM) ☒ Specific Plan or Specific Plan Amendment
☐ Minor Subdivision (TPM) ☐ Certificate of Compliance:
☒ Boundary Adjustment
☐ Rezone (Reclassification) from _____ to _____ zone.
☐ Major Use Permit (MUP), purpose: _____
☐ Time Extension... Case No. _____
☐ Expired Map... Case No. _____
☒ Other: General Plan Amendments

Assessor's Parcel Number(s)
(Add extra if necessary)

SEE ATTACHED

- B. ☒ Residential Total number of dwelling units 1,110
☒ Commercial Gross floor area 7,600 square feet
☒ Industrial Gross floor area
☒ Other Gross floor area 8.7 acre school, 2.3 acre fire station, parks

- C. ☒ Total Project acreage 1,283.5 Total number of lots 895

- D. Is the project proposing the use of groundwater? ☐ Yes ☒ No
Is the project proposing the use of reclaimed water? ☐ Yes ☒ No

Thomas Guide Page 1292 Grid C7

12800 Proctor Valley Road, Chula Vista, CA

Project address Street

Jamul Dulzura/Otay Subregion 91914

Community Planning Area/Subregion Zip

Owner/Applicant agrees to pay all necessary construction costs, dedicate all district required easements to extend service to the project and
COMPLETE ALL CONDITIONS REQUIRED BY THE DISTRICT.

Applicant's Signature: [Signature] Date: 10/19/2016

Address: 2245 San Diego Ave, Suite 223, San Diego, CA 92110 Phone: (619) 267-4904

(On completion of above, present to the district that provides water protection to complete Section 2 below.)

SECTION 2: FACILITY AVAILABILITY

TO BE COMPLETED BY DISTRICT

District Name: OTAY WATER DISTRICT Service area: WATER TO 22

- A. ☐ Project is in the district.
☒ Project is not in the district but is within its Sphere of Influence boundary, owner must apply for annexation.
☐ Project is not in the district and is not within its Sphere of Influence boundary.
☐ The project is not located entirely within the district and a potential boundary issue exists with the _____ District.

- B. ☒ Facilities to serve the project ☒ ARE ☐ ARE NOT reasonably expected to be available within the next 5 years based on the capital facility plans of the district. Explain in space below or on attached _____. (Number of sheets)
☐ Project will not be served for the following reason(s): _____

- C. ☒ District conditions are attached. Number of sheets attached: _____
☐ District has specific water reclamation conditions which are attached. Number of sheets attached: _____
☐ District will submit conditions at a later date.

- D. ☐ How far will the pipeline(s) have to be extended to serve the project? _____

This Project Facility Availability Form is valid until final discretionary action is taken pursuant to the application for the proposed project or until it is withdrawn, unless a shorter expiration date is otherwise noted.

Authorized Signature: [Signature] Print Name: Tanya Romero
Print Title: Permit Technician Phone: (619) 470-2241 Date: 10/25/16

NOTE: THIS DOCUMENT IS NOT A COMMITMENT OF SERVICE OR FACILITIES BY THE DISTRICT
On completion of Section 2 and 3 by the District, applicant is to submit this form with application to:
Planning & Development Services - Zoning Counter, 5510 Overland Ave, Suite 110, San Diego, CA 92123



PDS-399W (Rev. 09/21/2012)

THIS APPROVAL OF AVAILABILITY IS
SUBJECT TO ALL OTAY WATER DISTRICT
REQUIREMENTS IN EFFECT AT THE TIME OF
APPLICATION FOR SERVICE.



...Dedicated to Community Service

2554 SWEETWATER SPRINGS BOULEVARD, SPRING VALLEY, CALIFORNIA 91978-2004
TELEPHONE: 670-2222, AREA CODE 619

www.otaywater.gov

*Sent via USPS and email to:
rcameron@jacksonpendo.com*

October 31, 2016

Project No.: D0956-090248
Activity: 3111

Rob Cameron
GDCI Proctor Valley, LP
c/o Jackson Pendo Development
2245 San Diego Avenue, Suite 223
San Diego, CA 92110

Subject: Project Facility Availability – Water
The Proctor Valley Village 14 Preserve Specific Plan and Planning Areas
16/19;
12800 Proctor Valley Road Chula Vista, CA

Dear Mr. Cameron:

This letter supersedes the previously written dated April 6, 2016. The Otay Water District (District) has the capacity to serve the Otay Ranch Village 14 (Project). As provided to the District, the Project consists of sixteen (16) parcels and nine hundred ninety-five (995) lots totaling approximately 1,283.5 total acreage.

As per Section 62.01 of the District's Code of Ordinances, "To provide for future line extensions, pipelines installed within public streets must be constructed to the subdivision boundary and pipelines not installed within a public street must be installed in a District easement or right-of-way and must extend across the frontage of the parcel or parcels to be served."

The District has no objection to this Project. The developer will be required to submit both a water demand study and a Water Supply Assessment and Verification report (WSA&V). The water study must be reviewed and approved by the District before the County of San Diego submits the request for a WSA&V report to the District. The developer should meet with the District early in the entitlement process to discuss the schedule, report submittal requirements, and to set up a deposit account to cover staff time. The developer will also be required to submit a Sub-Area Master Plan and a calculation of water demands prior to the commencement of the Project. An agreement between the developer and the District will be needed for the design and construction of water system improvements including transmission pipelines, reservoirs and pump stations required to support this development. In addition, the developer will be required to annex parcels into an improvement district for water service.

Rob Cameron
Project Facility Availability – Water
October 31, 2016
Page 2 of 3.

The developer will be required to submit improvement plans for District approval and extend the water main to front all properties in question. If service laterals do not exist for the Project, the applicant must pay to have the District install them.

Prior to the purchase of any meter(s), irrigation plans must be: (1) designed to District Water Agency Standards for reclaimed standards/specifications and (2) submitted to the District and the County Department of Environmental Health (DEH) for plan check and approval. The developer must contact the District for further requirements.

When a customer requests water service on a parcel of land with potable water irrigated landscape equal to 5,000 square-feet or more, a separate meter will be required for irrigation purposes on the site. Each service must have an approved reduced pressure principle backflow prevention device (R/P).

Fire service plans must be designed to Water Agencies' Standards. Each service must have an R/P purchased and installed by the developer after District review and approval. The developer should contact the Project's fire agency for any fire protection requirements and determine early on how the fire protection requirements can be met from the existing pressure zone.

The fire service line will not be allowed to be connected to any buildings; the line will be intended for fire services purposes only. Failure to comply with this request will result in violation of the District's Code of Ordinances and will be subject to penalties determined by the District. Water furnished for fire hydrant or fire sprinkler service shall be used only for fire protection purposes and shall be connected to a District water main. Where service is provided for a fire hydrant or fire sprinkler service on privately owned land, the service shall be provided by the District at the property line of land to be served

Water availability is subject to all District requirements in effect at the time and you are strongly encouraged to adopt water conservation measures throughout the development.

The District's Engineering Public Services Division can be contacted at (619) 670-2241 or visit the website at www.otaywater.gov/engineering for further requirements regarding inspection services, water main extensions, service laterals, backflow devices, meter costs. Also, visit the website at www.otaywater.gov/code-of-ordinances for sections pertaining to the Project and any other conditions that may have arisen since this letter was written for this Project.

Returned herewith are the documents you forwarded with your review request.

Rob Cameron
Project Facility Availability – Water
October 31, 2016
Page 3 of 3.

Sincerely,
OTAY WATER DISTRICT



Dan Martin, P.E.
Engineering Manager

DM:mlc

Enclosure: Documents submitted with review request

cc: County Of San Diego, Planning & Development Services – Zoning Counter (w/o
enclosures)

**Otay Ranch Proctor Valley Village 14 and Preserve
APNs By Ownership**

Village 14

1. 598-070-09
2. 598-070-07
3. 598-010-02
4. 598-020-04
5. 598-020-06
6. 598-021-02
7. 597-140-05

Planning Areas 16/19

1. 597-020-10
2. 597-140-04
3. 597-020-06
4. 597-190-23
5. 597-150-13
6. 597-150-03
7. 597-150-12
8. 597-150-07
9. 597-150-08

COPY



...Dedicated to Community Service

2554 SWEETWATER SPRINGS BOULEVARD, SPRING VALLEY, CALIFORNIA 91978-2004
TELEPHONE: 670-2222, AREA CODE 619

www.otaywater.gov

*Sent via USPS and email to:
rcameron@jacksonpendo.com*

April 6, 2016

Project No.: D0956-090248
Activity: 3111

Rob Cameron
GDCI Proctor Valley, LP
c/o Jackson Pendo Development
2245 San Diego Avenue, Suite 223
San Diego, CA 92110

Subject: Project Facility Availability – Water
The Proctor Valley Village 14 Preserve Specific Plan and Planning Areas
16/19;
12800 Proctor Valley Road Chula Vista, CA

Dear Mr. Cameron:

The Otay Water District (District) has the capacity to serve the Otay Ranch Village 14 (Project). As provided to the District, the Project consists of thirty (30) parcels (approximately 2,347 total acreage).

As per Section 62.01 of the District's Code of Ordinances (enclosed), "To provide for future line extensions, pipelines installed within public streets must be constructed to the subdivision boundary and pipelines not installed within a public street must be installed in a District easement or right-of-way and must extend across the frontage of the parcel or parcels to be served."

The District has no objection to this Project. The developer will be required to submit both a water demand study and a Water Supply Assessment and Verification report (WSA&V). The water study must be reviewed and approved by the District before the County of San Diego submits the request for a WSA&V report to the District. The developer should meet with the District early in the entitlement process to discuss the schedule, report submittal requirements, and to set up a deposit account to cover staff time. The developer will also be required to submit a Sub-Area Master Plan and a calculation of water demands prior to the commencement of the Project. An agreement between the developer and the District will be needed for the design and construction of water system improvement including transmission pipelines, reservoirs and pump stations required to support this development. In addition, the developer will be required to annex parcels into an improvement district. The developer will be required to submit improvement plans for District approval and extend the water main to front all properties in question. If service laterals do not exist for the Project, the applicant must pay to have the District install them.

Rob Cameron
Project Facility Availability – Water
April 6, 2016
Page 2 of 2.

Prior to the purchase of any meter(s), irrigation plans must be: (1) designed to District Water Agency Standards for reclaimed standards/specifications and (2) submitted to the District and the County Department of Environmental Health (DEH) for plan check and approval. The developer must contact the District for further requirements.

When a customer requests water service on a parcel of land with potable water irrigated landscape equal to 5,000 square-feet or more, a separate meter will be required for irrigation purposes on the site.

Each service must have an approved reduced pressure principle backflow prevention device (R/P) purchased and installed by the developer. The fire service line will not be allowed to be connected to any buildings; the line will be intended for fire services purposes only. Failure to comply with this request will result in violation of the District's Code of Ordinances and will be subject to penalties determined by the District. Water furnished for fire hydrant or fire sprinkler service shall be used only for fire protection purposes and shall be connected to a District water main. Where service is provided for fire hydrant or fire sprinkler service on privately-owned land, the service shall be provided by the District at the property line of land to be served. The developer should contact the Project's fire agency for any fire protection requirements.

Water availability is subject to all District requirements in effect at the time and you are strongly encouraged to adopt water conservation measures throughout the development.

The District's Engineering Public Services Division can be contacted at (619) 670-2241 or visit the website at www.otaywater.gov for further requirements regarding inspection services, water main extensions, service laterals, backflow devices, meter costs, and any other conditions that may have arisen since this letter was written for this Project.

Also, returned herewith are the documents you forwarded with your review request.

Sincerely,
OTAY WATER DISTRICT



Dan Martin, P.E.
Engineering Manager

DM:mlc

Enclosures: Location Map
Code of Ordinances (Sections 9, 23, 25, 26, 27, 28, 36, 38, 39, 40, 60, 62)
Documents submitted with review request

COPY



County of San Diego, Planning & Development Services
PROJECT FACILITY AVAILABILITY - WATER
ZONING DIVISION

Please type or use pen

GDCI Proctor Valley, LP	619-267-4904	ORG _____	W
Owner's Name	Phone	ACCT _____	
c/o Jackson Pendo Development 2245 San Diego Ave, Suite 223		ACT _____	
Owner's Mailing Address	Street	TASK _____	
San Diego	CA 92110	DATE _____	
City	State	Zip	AMT \$ _____

DISTRICT CASHIER'S USE ONLY

SECTION 1. PROJECT DESCRIPTION**TO BE COMPLETED BY APPLICANT**

- A. ☒ Major Subdivision (TM) ☒ Specific Plan or Specific Plan Amendment
☒ Minor Subdivision (TPM) ☐ Certificate of Compliance: _____
☒ Boundary Adjustment
☒ Rezone (Reclassification) from S80/S86/RR to S80/others zone.
☐ Major Use Permit (MUP), purpose: _____
☐ Time Extension...Case No. _____
☐ Expired Map...Case No. _____
☒ Other General Plan Amendments _____

Assessor's Parcel Number(s)
 (Add extra if necessary)

SEE ATTACHED

- B. ☒ Residential Total number of dwelling units 1,530
☒ Commercial Gross floor area 15,000 square feet
☐ Industrial Gross floor area _____
☒ Other Gross floor area 8.6 acre school, 2.3 acre fire, parks

- C. ☒ Total Project acreage 2,347 Total number of lots 1,316

- D. Is the project proposing the use of groundwater? ☐ Yes ☒ No
 Is the project proposing the use of reclaimed water? ☐ Yes ☒ No

Thomas Guide Page 1292 Grid C7

12800 Proctor Valley Road, Chula Vista, CA

Project address Street

Jamul Dulzura/Otay Subregion 91914

Community Planning Area/Subregion Zip

Owner/Applicant agrees to pay all necessary construction costs, dedicate all district required easements to extend service to the project and
 COMPLETE ALL CONDITIONS REQUIRED BY THE DISTRICT.

Applicant's Signature: [Signature]

Date: 3/25/16

Address: 2245 San Diego Ave, Suite 223, San Diego, CA 92110

Phone: (619) 267-4904

(On completion of above, present to the district that provides water protection to complete Section 2 below.)

SECTION 2: FACILITY AVAILABILITY**TO BE COMPLETED BY DISTRICT**District Name: OTAY WATER DISTRICTService area: Water ID 22

- A. ☐ Project is in the district.
☒ Project is not in the district but is within its Sphere of Influence boundary, owner must apply for annexation.
☐ Project is not in the district and is not within its Sphere of Influence boundary.
☐ The project is not located entirely within the district and a potential boundary issue exists with the _____ District.
- B. ☒ Facilities to serve the project ☒ ARE ☐ ARE NOT reasonably expected to be available within the next 5 years based on the capital facility plans of the district. Explain in space below or on attached _____. (Number of sheets)
☐ Project will not be served for the following reason(s): _____
- C. ☒ District conditions are attached. Number of sheets attached: _____
☐ District has specific water reclamation conditions which are attached. Number of sheets attached: _____
☐ District will submit conditions at a later date.
- D. ☐ How far will the pipeline(s) have to be extended to serve the project? _____

This Project Facility Availability Form is valid until final discretionary action is taken pursuant to the application for the proposed project or until it is withdrawn, unless a shorter expiration date is otherwise noted.

Authorized Signature: [Signature]Print Name: Tanya RomeroPrint Title: PERMIT TECHNICIANPhone: (619) 670-2241Date: 4/5/16

NOTE: THIS DOCUMENT IS NOT A COMMITMENT OF SERVICE OR FACILITIES BY THE DISTRICT
 On completion of Section 2 and 3 by the District, applicant is to submit this form with application to:
 Planning & Development Services - Zoning Counter, 5510 Overland Ave, Suite 110, San Diego, CA 92123



PDS-399W (Rev. 09/21/2012)

THIS APPROVAL OF AVAILABILITY IS
 SUBJECT TO ALL OTAY WATER DISTRICT
 REQUIREMENTS IN EFFECT AT THE TIME
 OF APPLICATION FOR SERVICE

APPENDIX E

Fire Behavior Modeling Input Data

APPENDIX E

Fire Behavior Modeling

Otay Ranch Village 14 and Planning Areas 16/19

BEHAVEPLUS FIRE BEHAVIOR MODELING

Fire behavior modeling has been used by researchers for approximately 50 years to predict how a fire will move through a given landscape (Linn 2003). The models have had varied complexities and applications throughout the years. One model has become the most widely used as the industry standard for predicting fire behavior on a given landscape. That model, known as “BEHAVE”, was developed by the U. S. Government (USDA Forest Service, Rocky Mountain Research Station) and has been in use since 1984. Since that time, it has undergone continued research, improvements, and refinement. The current version, BehavePlus, 5.0.5, includes the latest updates incorporating years of research and testing. Numerous studies have been completed testing the validity of the fire behavior models’ ability to predict fire behavior given site specific inputs. One of the most successful ways the model has been improved has been through post-wildfire modeling (Brown 1972, Lawson 1972, Sneeuwjagt and Frandsen 1977, Andrews 1980, Brown 1982, Rothermel and Rinehart 1983, Bushey 1985, McAlpine and Xanthopoulos 1989, Grabner, et. al. 1994, Marsden-Smedley and Catchpole 1995, Grabner 1996, Alexander 1998, Grabner et al. 2001, Arca et al. 2005). In this type of study, Behave is used to model fire behavior based on pre-fire conditions in an area that recently burned. Real-world fire behavior, documented during the wildfire, can then be compared to the prediction results of Behave and refinements to the fuel models incorporated, retested, and so on.

Fire behavior modeling includes a high level of analysis and information detail to arrive at reasonably accurate representations of how wildfire would move through available fuels on a given site. Fire behavior calculations are based on site-specific fuel characteristics supported by fire science research that analyzes heat transfer related to specific fire behavior. To objectively predict flame lengths, spread rates, and fireline intensities, the BehavePlus 5.0.5 fire behavior modeling system was applied using predominant fuel characteristics, slope percentages, and three representative fuel models observed on site.

Predicting wildland fire behavior is not an exact science. As such, the movement of a fire will likely never be fully predictable, especially considering the variations in weather and the limits of weather forecasting. Nevertheless, practiced and experienced judgment, coupled with a validated fire behavior modeling system, results in useful and accurate fire prevention planning information.

To be used effectively, the basic assumptions and limitations of BehavePlus must be understood.

- First, it must be realized that the fire model describes fire behavior only in the flaming front. The primary driving force in the predictive calculations is dead fuels less than one-quarter inch in diameter. These are the fine fuels that carry fire. Fuels greater than one inch have little effect while fuels greater than three inches have no effect on fire behavior.

APPENDIX E (Continued)

- Second, the model bases calculations and descriptions on a wildfire spreading through surface fuels that are within six feet of the ground and contiguous to the ground. Surface fuels are often classified as grass, brush, litter, or slash.
- Third, the software assumes that weather and topography are uniform. However, because wildfires almost always burn under non-uniform conditions, length of projection period and choice of fuel model must be carefully considered to obtain useful predictions.
- Fourth, the BehavePlus fire behavior computer modeling system was not intended for determining sufficient fuel modification zone widths. However, it does provide the average length of the flames, which is a key element for determining “defensible space” distances for minimizing structure ignition.

Although BehavePlus has some limitations, it can still provide valuable fire behavior predictions which can be used as a tool in the decision-making process. In order to make reliable estimates of fire behavior, one must understand the relationship of fuels to the fire environment and be able to recognize the variations in these fuels. Natural fuels are made up of the various components of vegetation, both live and dead, that occur on a site. The type and quantity will depend upon the soil, climate, geographic features, and the fire history of the site. The major fuel groups of grass, shrub, trees, and slash are defined by their constituent types and quantities of litter and duff layers, dead woody material, grasses and forbs, shrubs, regeneration, and trees. Fire behavior can be predicted largely by analyzing the characteristics of these fuels. Fire behavior is affected by seven principal fuel characteristics: fuel loading, size and shape, compactness, horizontal continuity, vertical arrangement, moisture content, and chemical properties.

The seven fuel characteristics help define the 13 standard fire behavior fuel models (Anderson 1982) and the five custom fuel models developed for Southern California (Weise 1997). According to the model classifications, fuel models used in BehavePlus have been classified into four groups, based upon fuel loading (tons/acre), fuel height, and surface to volume ratio. Observation of the fuels in the field (on site) determines which fuel models should be applied in BehavePlus. The following describes the distribution of fuel models among general vegetation types for the standard 13 fuel models and the custom Southern California fuel models:

- Grasses Fuel Models 1 through 3
- Brush Fuel Models 4 through 7, SCAL 14 through 18
- Timber Fuel Models 8 through 10
- Logging Slash Fuel Models 11 through 13

In addition, the aforementioned fuel characteristics were utilized in the recent development of 40 new fire behavior fuel models (Scott and Burgan 2005) developed for use in BehavePlus modeling efforts. These new models attempt to improve the accuracy of the standard 13 fuel

APPENDIX E (Continued)

models outside of severe fire season conditions, and to allow for the simulation of fuel treatment prescriptions. The following describes the distribution of fuel models among general vegetation types for the new 40 fuel models:

- Non-Burnable Models NB1, NB2, NB3, NB8, NB9
- Grass Models GR1 through GR9
- Grass-shrub Models GS1 through GS4
- Shrub Models SH1 through SH9
- Timber-understory Models TU1 through TU5
- Timber litter Models TL1 through TL9
- Slash blowdown Models SB1 through SB4

BehavePlus software was used in the development of this fire protection plan (FPP) in order to evaluate potential fire behavior for the Project site. Existing site conditions were evaluated, and local weather data was incorporated into the BehavePlus modeling runs.

BEHAVEPLUS FUEL MODEL INPUTS

Dudek utilized BehavePlus software to evaluate fire behavior potential for the project site. Six fire scenarios were evaluated, including three summer, onshore weather conditions and three more extreme fall, offshore weather conditions. BehavePlus software requires site-specific variables for surface fire spread analysis, including fuel type, fuel moisture, wind speed, and slope data. The output variables used in this analysis include flame length (feet), rate of spread (feet/minute), and fireline intensity (BTU/feet/second). The following provides a description of the input variables used in processing the BehavePlus models for the project site. In addition, data sources are cited and any assumptions made during the modeling process are described.

Vegetation/Fuel Models

To support the fire behavior modeling efforts conducted for this FPP, the different vegetation types observed on and adjacent to the site were classified into the aforementioned numeric fuel models. Vegetation types were derived from vegetation mapping data (Dudek 2015) for the project site. The site and off site vegetation consists primarily of Diegan coastal sage scrub (Fuel Model SCAL 18), chamise chaparral (Fuel Model Sh5), and short grasses (Fuel Model 1). Modeled areas include the non-native grasslands to the north, east, and south of the project site. Coastal sage scrub and chamise chaparral occur on the slopes to the north, southeast, and west of the site. A total of six fire modeling scenarios were completed for the Project area. These sites were selected based on the strong likelihood of fire approaching from these directions during an

APPENDIX E (Continued)

on-shore weather pattern (fire scenarios 1, 5, and 6) and during a Santa Ana wind-driven fire event (fire scenarios 2, 3, and 4).

Topography

Slope is a measure of angle in degrees from horizontal and can be presented in units of degrees or percent. Slope is important in fire behavior analysis as it affects the exposure of fuel beds. Additionally, fire burning uphill spreads faster than those burning on flat terrain or downhill as uphill vegetation is pre-heated and dried in advance of the flaming front, resulting in faster ignition rates. Slope values ranging from 5% to 40% were measured around the perimeter of the proposed project site from U.S. Geological Survey (USGS) topographic maps and current topography that was flown by Dudek.

Weather Analysis

In order to evaluate specific weather variables for the Project area, data from the San Miguel Remote Automated Weather Station (RAWS) was analyzed. The San Miguel RAWS is the closest RAWS, located approximately 3.2 miles due northwest of the Project site, in a similar inland position and estimated to include consistent weather conditions as the Project area. The location and available data range for the San Miguel station is:

- San Miguel RAWS
 - Latitude: 32.68611
 - Longitude: -116.97833
 - Elevation: 425 feet
 - Data years: 2002 to 2010

Utilizing the FireFamily Plus v. 4.0.2 (FireFamily Plus 2008) software package, data from the San Miguel RAWS was processed and analyzed to determine 50th (typical) and 97th (extreme) percentile wind and fuel moisture conditions to be used in the fire behavior modeling efforts conducted for the Project area. Wind speed values derived from RAWS data represent 20-foot wind speeds. As such, a wind adjustment factor of 0.4 was utilized to account for vertical differences in wind speed from the 20-foot recording height to mid-flame height prior to BehavePlus modeling efforts. Standard RAWS setup places the anemometer at 20 feet above ground, while wind affecting surface fire spread is that found at mid-flame height. A conservative wind adjustment factor of 0.4 indicates a fuel bed that is unsheltered from the wind with a fuel bed depth roughly 3.0 feet. It should be noted that mid-flame wind speeds may be only 10% of the wind speeds recorded or predicted at 20 feet. Fuel moisture information derived from FireFamily Plus was directly inputted into the BehavePlus runs. Two separate wind

APPENDIX E (Continued)

scenarios were analyzed and incorporated into the BehavePlus model: summer fire (50th percentile values from June 1 to August 31) with 8 mph on-shore winds, and fall fire (97th percentile values from September 1 to November 30) with 30 to 50 mph winds. The use of 50 mph winds in modeling efforts is intended to represent wind gusts rather than sustained maximum wind speeds (30-40 mph). The maximum RAWS wind speed for the San Miguel RAWS during the 97th percentile weather period (September 1 to November 30) was 20 mph, which represents a 10-minute average wind speed, not the maximum gust speed. As BehavePlus presents a static representation of fire behavior, the inclusion of gust speed is appropriate to evaluate worst-case fire behavior outputs. Table 2 summarizes the weather and wind input variables used for all fire behavior modeling conducted for this FPP.

Table 2
BehavePlus Fire Behavior Model Variables

Variable	Summer Weather (Onshore Flow) 50 th Percentile	Peak Weather (Offshore Flow) 97 th Percentile
Fire Modelling Scenarios	1, 5, 6	2, 3, 4
Fuel Model(s)	FM 1, Sh5, SCAL 18	FM 1, Sh5, SCAL 18
1h Moisture	8%	2%
10h Moisture	10%	3%
100h Moisture	15%	7%
Live Herbaceous Moisture	90%	60%
Live Woody Moisture	122%	92%
20-ft Wind Speed	8 mph	30-40 mph (50 mph gusts)
Wind Adjustment Factor (BehavePlus)	0.4	0.4
Slope Steepness	5-40%	10-30%

Fire Modeling Scenarios

Focused fire behavior modeling utilizing BehavePlus 5.0.5 was conducted for the Project. Based on slope and fuel conditions, six different fire scenarios were evaluated for the project site, including:

- **Scenario 1:** 50th percentile weather with on-shore wind and a summer fire burning in grassland with sparse sage scrub and chamise chaparral shrub cover along the southern edge of the Project site. This area is relatively flat (5% slope) to moderately slope (20%), with potential ignition sources along adjacent residential areas, a transmission line, or off-road recreational vehicles. Fire in this area would be moving slightly uphill toward the proposed Project.
- **Scenario 2:** 97th percentile weather with off-shore wind and a fall fire burning in chamise chaparral and coastal sage scrub shrub cover in rugged terrain along the eastern

APPENDIX E (Continued)

edge of the Project site. This area is moderately steep (20 to 30% slope), with potential ignition sources from off-road vehicles, or from a larger fire burning westward over the Jamul Mountains that could have started near SR-94 to the east. Fire in this area would be moving downhill toward the proposed Project.

- **Scenario 3:** 97th percentile weather with off-shore wind and a fall fire burning in grasslands and coastal sage scrub shrub cover in gentle terrain along the northeastern portion of the Project site. This area starts off as relatively flat terrain (10%) and then abruptly becoming moderately steep slopes (27%). Potential ignition sources could be off-road vehicle activity or from a larger fire burning westward from the Dulzura area and SR-94 to the east. Fire in this area would be moving downhill toward the proposed Project.
- **Scenario 4:** 97th percentile weather with off-shore wind and a fall fire burning in grasslands and coastal sage scrub shrub cover in gentle, undulating terrain along the northern portion of the Project site. This area is rolling hills with roughly 10% - 15% slopes. Potential ignition sources could be adjacent residential areas in Jamul or off-road vehicle activity. Fire in this area would be moving upslope toward the proposed Project.
- **Scenario 5:** 50th percentile weather with on-shore wind and a summer fire burning in grasslands, or chamise and sage scrub shrub cover along the western edge of the project site. This area is moderately steep (20% slope) with potential ignition sources from a larger fire burning eastward over the Jamul Mountains. Fire in this area would be moving downhill toward the proposed Project.
- **Scenario 6:** 50th percentile weather with on-shore wind and a summer fire burning in chamise and sage scrub shrub cover along the southwestern edge of the project site. This area is steep (up to 40% slope), with potential ignition sources from a transmission line or a wildfire that originates in the San Diego National Wildlife Refuge to the west of the Proctor Valley. Fire in this area would be moving downhill toward the proposed Project.

FIRE BEHAVIOR MODELING EFFORT

As mentioned, the BehavePlus fire behavior modeling software package was utilized in evaluating anticipated fire behavior within and adjacent to proposed fuel modification zones for the Village 14 and Planning area 16/19 project site. Six focused analyses were completed, each assuming worst-case fire weather conditions for a fire approaching the project site from the northeast, east, west, and south. Three fire behavior variables were selected as outputs from the BehavePlus analysis conducted for the project site, and include flame length (feet), rate of spread (mph), and fireline intensity (BTU/feet/second). The aforementioned fire behavior variables are an important component in understanding fire risk and fire agency response capabilities. Flame length, the length of the flame of a spreading surface fire within the flaming front, is measured from midway in the active flaming combustion zone to the average tip of the flames (Andrews,

APPENDIX E (Continued)

Bevins, and Seli 2004). . Fireline intensity is a measure of heat output from the flaming front, and also affects the potential for a surface fire to transition to a crown fire. Fire spread rate represents the speed at which the fire progresses through surface fuels and is another important variable in initial attack and fire suppression efforts (Rothermel 1983). The information in Table 3 presents an interpretation of these fire behavior variables as related to fire suppression efforts. The results of fire behavior modeling efforts are presented in Table 4. Identification of modeling run locations is presented graphically in Figure 5 of the FPP.

Based on the BehavePlus analysis, worst-case fire behavior is expected in sage scrub fuels along the northern and eastern edges of proposed project development (Scenarios 2, 3 , and 4) during a strong wind-driven fire event (97th percentile weather with 50 mph gusts). Under this scenario, maximum modeled flame lengths reach 34.3 feet, fireline intensities reach 12,338 BTU/feet/second, and spread rates reach 2.0 mph.

Table 3
Fire Suppression Interpretation

Flame Length (ft)	Fireline Intensity (Btu/ft/s)	Interpretations
Under 4 feet	Under 100 BTU/ft/s	Fires can generally be attacked at the head or flanks by persons using hand tools. Hand line should hold the fire.
4 to 8 feet	100-500 BTU/ft/s	Fires are too intense for direct attack on the head by persons using hand tools. Hand line cannot be relied on to hold the fire. Equipment such as dozers, pumpers, and retardant aircraft can be effective.
8 to 11 feet	500-1000 BTU/ft/s	Fires may present serious control problems -- torching out, crowning, and spotting. Control efforts at the fire head will probably be ineffective.
Over 11 feet	Over 1000 BTU/ft/s	Crowning, spotting, and major fire runs are probable. Control efforts at head of fire are ineffective.

Table 4
BehavePlus Fire Behavior Modeling Results

Fire Scenario	Flame Length (feet)	Spread Rate (mph)	Fireline Intensity (Btu/ft/s)	Spot Fire (miles)
<i>Scenario 1: 5-20% - flat to upslope; Summer weather condition</i>				
Short grass (FM 1)	2.8	<1.0	52	0.1
Chamise chaparral (SH5)	9.1	<1.0	697	0.2
Sage scrub (SCAL18)	10.7	<1.0	984	0.3
<i>Scenario 2: 20-30% - downslope; Peak weather Condition</i>				
Chamise chaparral (SH5)	30.2 (34.2)	3.3 (4.4)	9,372 (12,229)	1.6 (2.0)
Sage scrub (SCAL18)	30.6 (33.7)	1.6 (1.9)	9,655 (11,868)	1.6 (2.0)
<i>Scenario 3: 10-27% - upslope; Peak Weather Condition</i>				
Short grass (FM 1)	12.7 (12.7)	8.3 (8.3)	1,415 (1,415)	0.9 (1.0)
Sage scrub (SCAL18)	31.3 (34.3)	1.6 (2.0)	10,125 (12,338)	1.6 (2.0)

APPENDIX E (Continued)

Table 4
BehavePlus Fire Behavior Modeling Results

Fire Scenario	Flame Length (feet)	Spread Rate (mph)	Fireline Intensity (Btu/ft/s)	Spot Fire (miles)
<i>Scenario 4: 5-15% - upslope; Peak Weather Condition</i>				
Short grass (FM 1)	12.7 (12.7)	8.3 (8.3)	1,415 (1,415)	0.9 (1.0)
Sage scrub (SCAL18)	31.0 (34.0)	1.6 (1.9)	9,888 (12,101)	1.6 (2.0)
<i>Scenario 5: 20% - downslope; Summer weather condition</i>				
Short grass (FM 1)	3.0	<1.0	62	0.1
Chamise chaparral (SH5)	9.5	<1.0	759	0.2
Sage scrub (SCAL18)	11.1	<1.0	1,057	0.3
<i>Scenario 6: 40% - downslope; Summer weather Condition</i>				
Chamise chaparral (SH5)	7.6	<1.0	462	0.2
Sage scrub (SCAL18)	9.2	<1.0	706	0.2

Note:

* Parentheses represents modeling results for 50 mph wind gusts.

** It should be noted that the results presented in Table 4 depict values based on inputs to the BehavePlus software. Changes in slope, weather, or pockets of different fuel types are not accounted for in this analysis. Further, this modeling analysis assumes a correlation between the project site vegetation and fuel model characteristics. Model results should be used as a basis for planning only, as actual fire behavior for a given location will be affected by many factors, including unique weather patterns, small-scale topographic variations, or changing vegetation patterns.

REFERENCES

- Alexander, M.E. 1998. Crown fire thresholds in exotic pine plantations of Australasia. Australian National University, Canberra, Australian Capital Territory. Ph.D. Thesis. 228p.
- Anderson, Hal E. 1982. *Aids to Determining Fuel Models for Estimating Fire Behavior*. USDA Forest Service Gen. Tech. Report INT-122. Intermountain Forest and Range Experiment Station, Ogden, UT. http://www.fs.fed.us/rm/pubs_int/int_gtr122.pdf
- Andrews, P.L. 1980. Testing the fire behavior model. In *Proceedings 6th conference on fire and forest meteorology*. April 22–24, 1980. Seattle, WA: Society of American Foresters. Pp. 70–77.
- Andrews, Patricia L., Collin D. Bevins, and Robert C. Seli. 2008. BehavePlus fire modeling system, version 4.0: User's Guide. Gen. Tech. Rep. RMRS-GTR-106WWW Revised. Ogden, UT: Department of Agriculture, Forest Service, Rocky Mountain Research Station. 132p.
- Arca, Bachisio (a), M. Laconi (b), A. Maccioni (b), G. Pellizzaro (a), and M. Salis (b). 2005. Validation of Farsite Model in Mediterranean Area. (a) CNR – IBIMET, Institute of Biometeorology, Sassari, Italy; (b) DESA, Università di Sassari, Sassari, Italy.

APPENDIX E (Continued)


- Brown, J.K. 1972. Field test of a rate-of-fire-spread model in slash fuels. USDA Forest Service Res. Pap. Int-116. 24 p.
- Brown, J.K. 1982. Fuel and fire behavior prediction in big sagebrush. USDA Forest Service Res. Pap. INT-290. 10p.
- Bushey, C.L. 1985. Comparison of observed and predicted fire behavior in the sagebrush/bunchgrass vegetation-type. In J.N. Long (ed.), Fire management: The challenge of protection and use: Proceedings of a symposium. Society of American Foresters. Logan, UT. April 17–19, 1985. Pp. 187–201.
- Dudek. 2015. Draft Biological Technical Report, Proctor Valley Village 14 Project, San Diego County, California. June 2015.
- FireFamily Plus 2008. <http://www.firelab.org/project/firefamilyplus>.
- Grabner, K., J. Dwyer, and B. Cutter. 1994. “Validation of Behave Fire Behavior Predictions in Oak Savannas Using Five Fuel Models.” Proceedings from 11th Central Hardwood Forest Conference. 14 p.
- Grabner, K.W. 1996. “Validation of BEHAVE fire behavior predictions in established oak savannas.” M.S. thesis. University of Missouri, Columbia.
- Grabner, K.W., J.P. Dwyer, and B.E. Cutter. 2001. “Fuel model selection for BEHAVE in midwestern oak savannas.” *Northern Journal of Applied Forestry*. 18: 74–80.
- Lawson, B.D. 1972. Fire spread in lodgepole pine stands. Missoula, MT: University of Montana. 110 p. thesis.
- Linn, R. 2003. “Using Computer Simulations to Study Complex Fire Behavior.” Los Alamos National Laboratory, MS D401. Los Alamos, NM.
- Marsden-Smedley, J.B. and W.R. Catchpole. 1995. Fire behaviour modelling in Tasmanian buttongrass moorlands. II. Fire behaviour. *International Journal of Wildland Fire*. Volume 5(4), pp. 215–228.
- McAlpine, R.S. and G. Xanthopoulos. 1989. Predicted vs. observed fire spread rates in Ponderosa pine fuel beds: a test of American and Canadian systems. In Proceedings 10th conference on fire and forest meteorology, April 17–21, 1989. Ottawa, Ontario. pp. 287–294.

APPENDIX E (Continued)

- Rothermel, Richard C. 1983. How to predict the spread and intensity of forest and range fires. GTR INT-143. Ogden, Utah: USDA Forest Service Intermountain Research Station. 161
- Rothermel, R.C., and G.C. Rinehart. 1983. "Field procedures for verification and adjustment of fire behavior predictions." Res. Pap. INT-142. Ogden, UT: U.S. Department of Agriculture, Forest Service, Intermountain Forest and Range Experiment Station. 25 p.
- Scott, Joe H. and Robert E. Burgan. 2005. *Standard Fire Behavior Fuel Models: A Comprehensive Set for Use with Rothermel's Surface Fire Spread Model*. Gen. Tech. Rep. RMRS-GTR-153. Fort Collins, CO: U.S. Department of Agriculture, Forest Service, Rocky Mountain Research Station. 72 p.
- Sneeuwjagt, R.J., and W.H. Frandsen. 1977. "Behavior of experimental grass fires vs. predictions based on Rothermel's fire model." *Canadian Journal of Forest Resources*. 7:357–367.
- Weise, D.R. and J. Regelbrugge. 1997. Recent chaparral fuel modeling efforts. Prescribed Fire and Effects Research Unit, Riverside Fire Laboratory, Pacific Southwest Research Station. 5p.

APPENDIX F

Fire Department Travel Time Analysis (Figures)

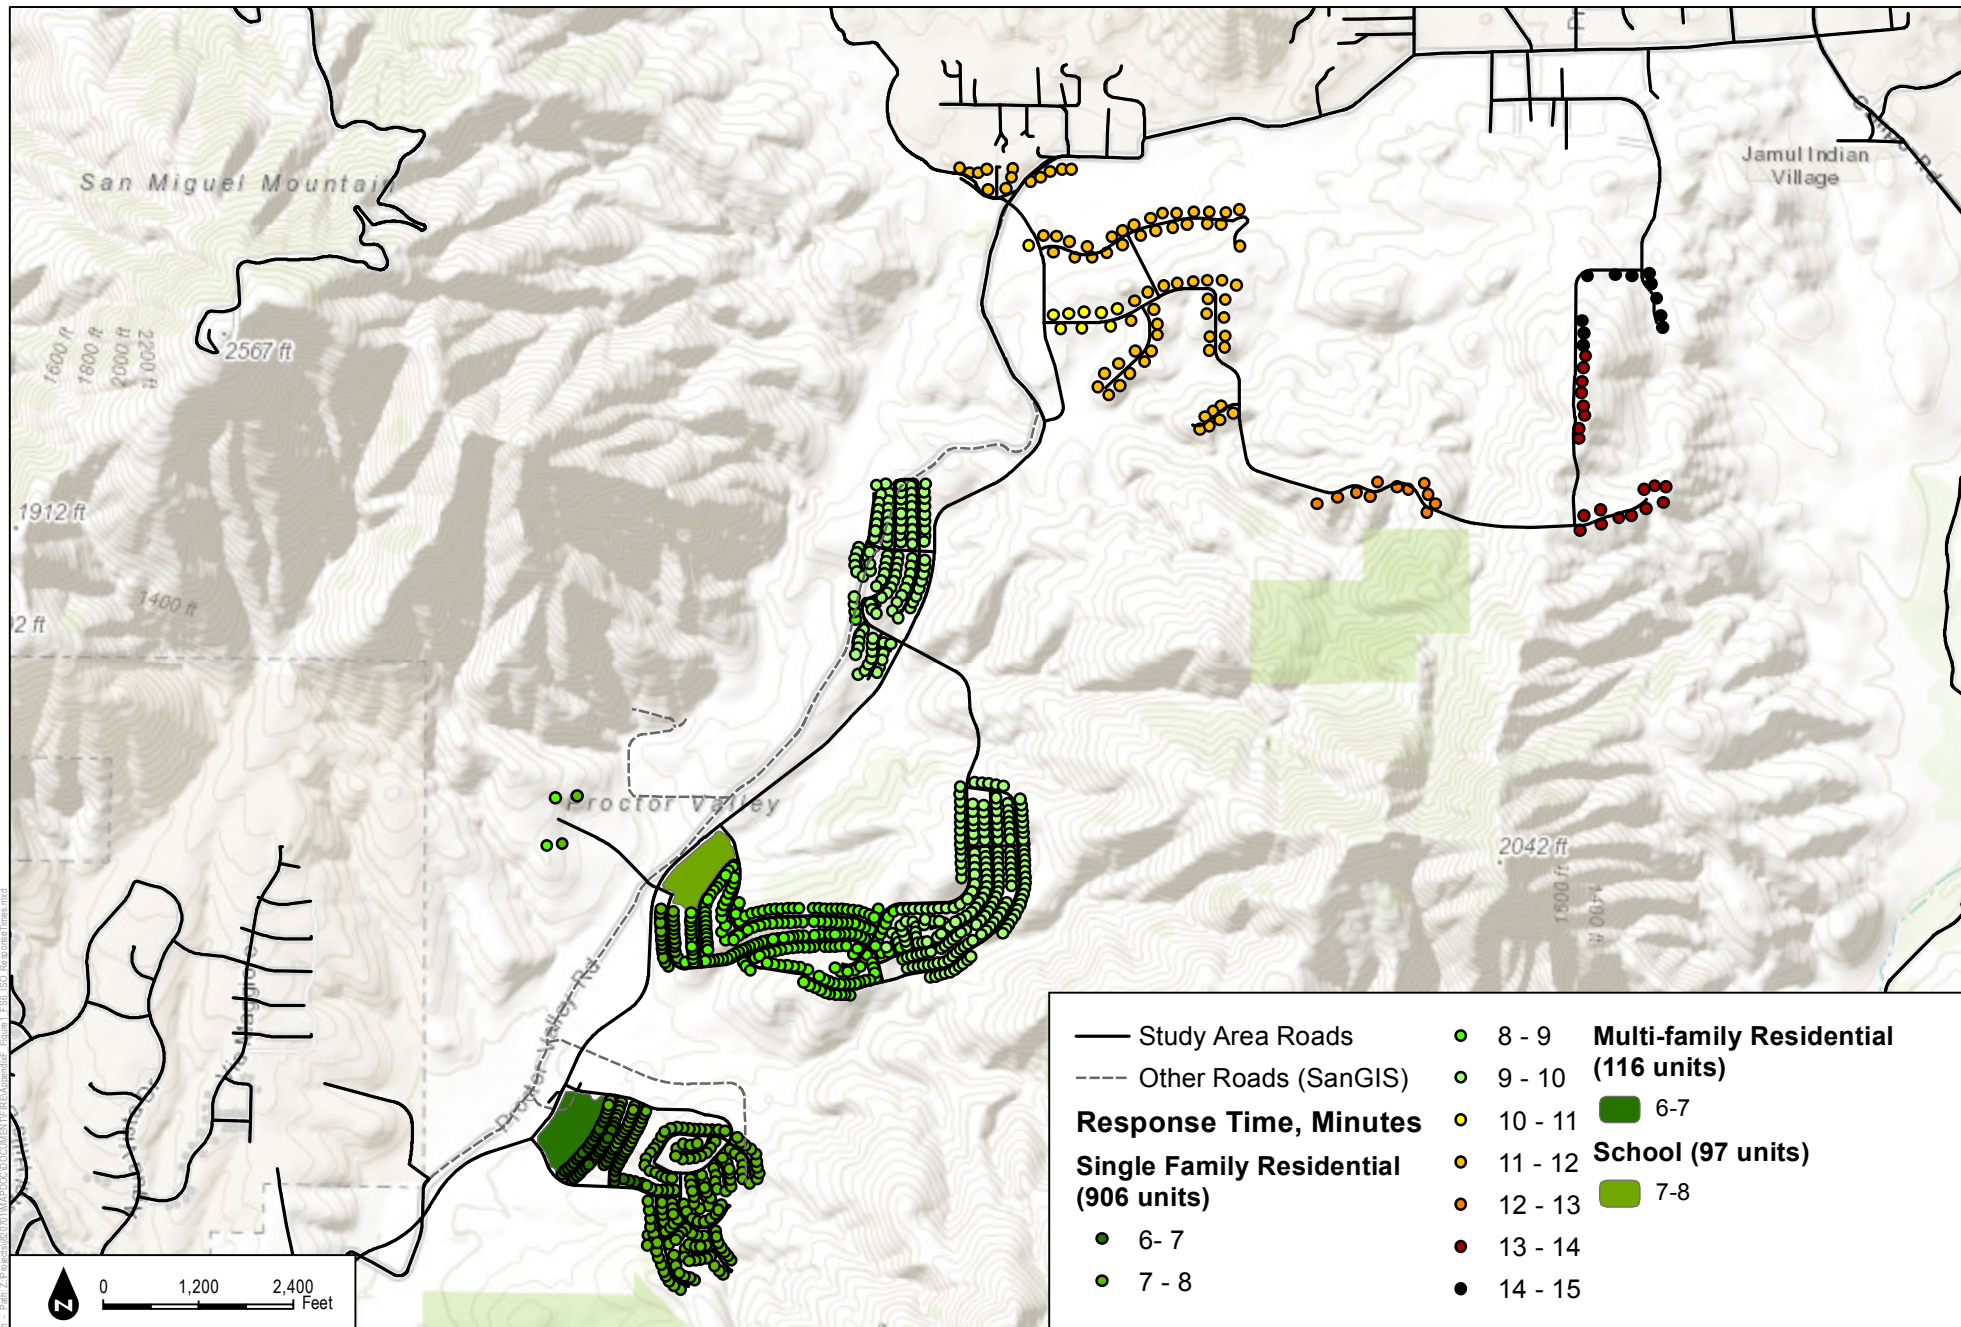


SOURCE: ESRI 2015; SANGIS 2015; Hunsaker 2015

Otay Ranch Village 14 and Planning Areas 16/19

APPENDIX F-1

Fire Station 6 - ISO Response Analysis

DUDEK

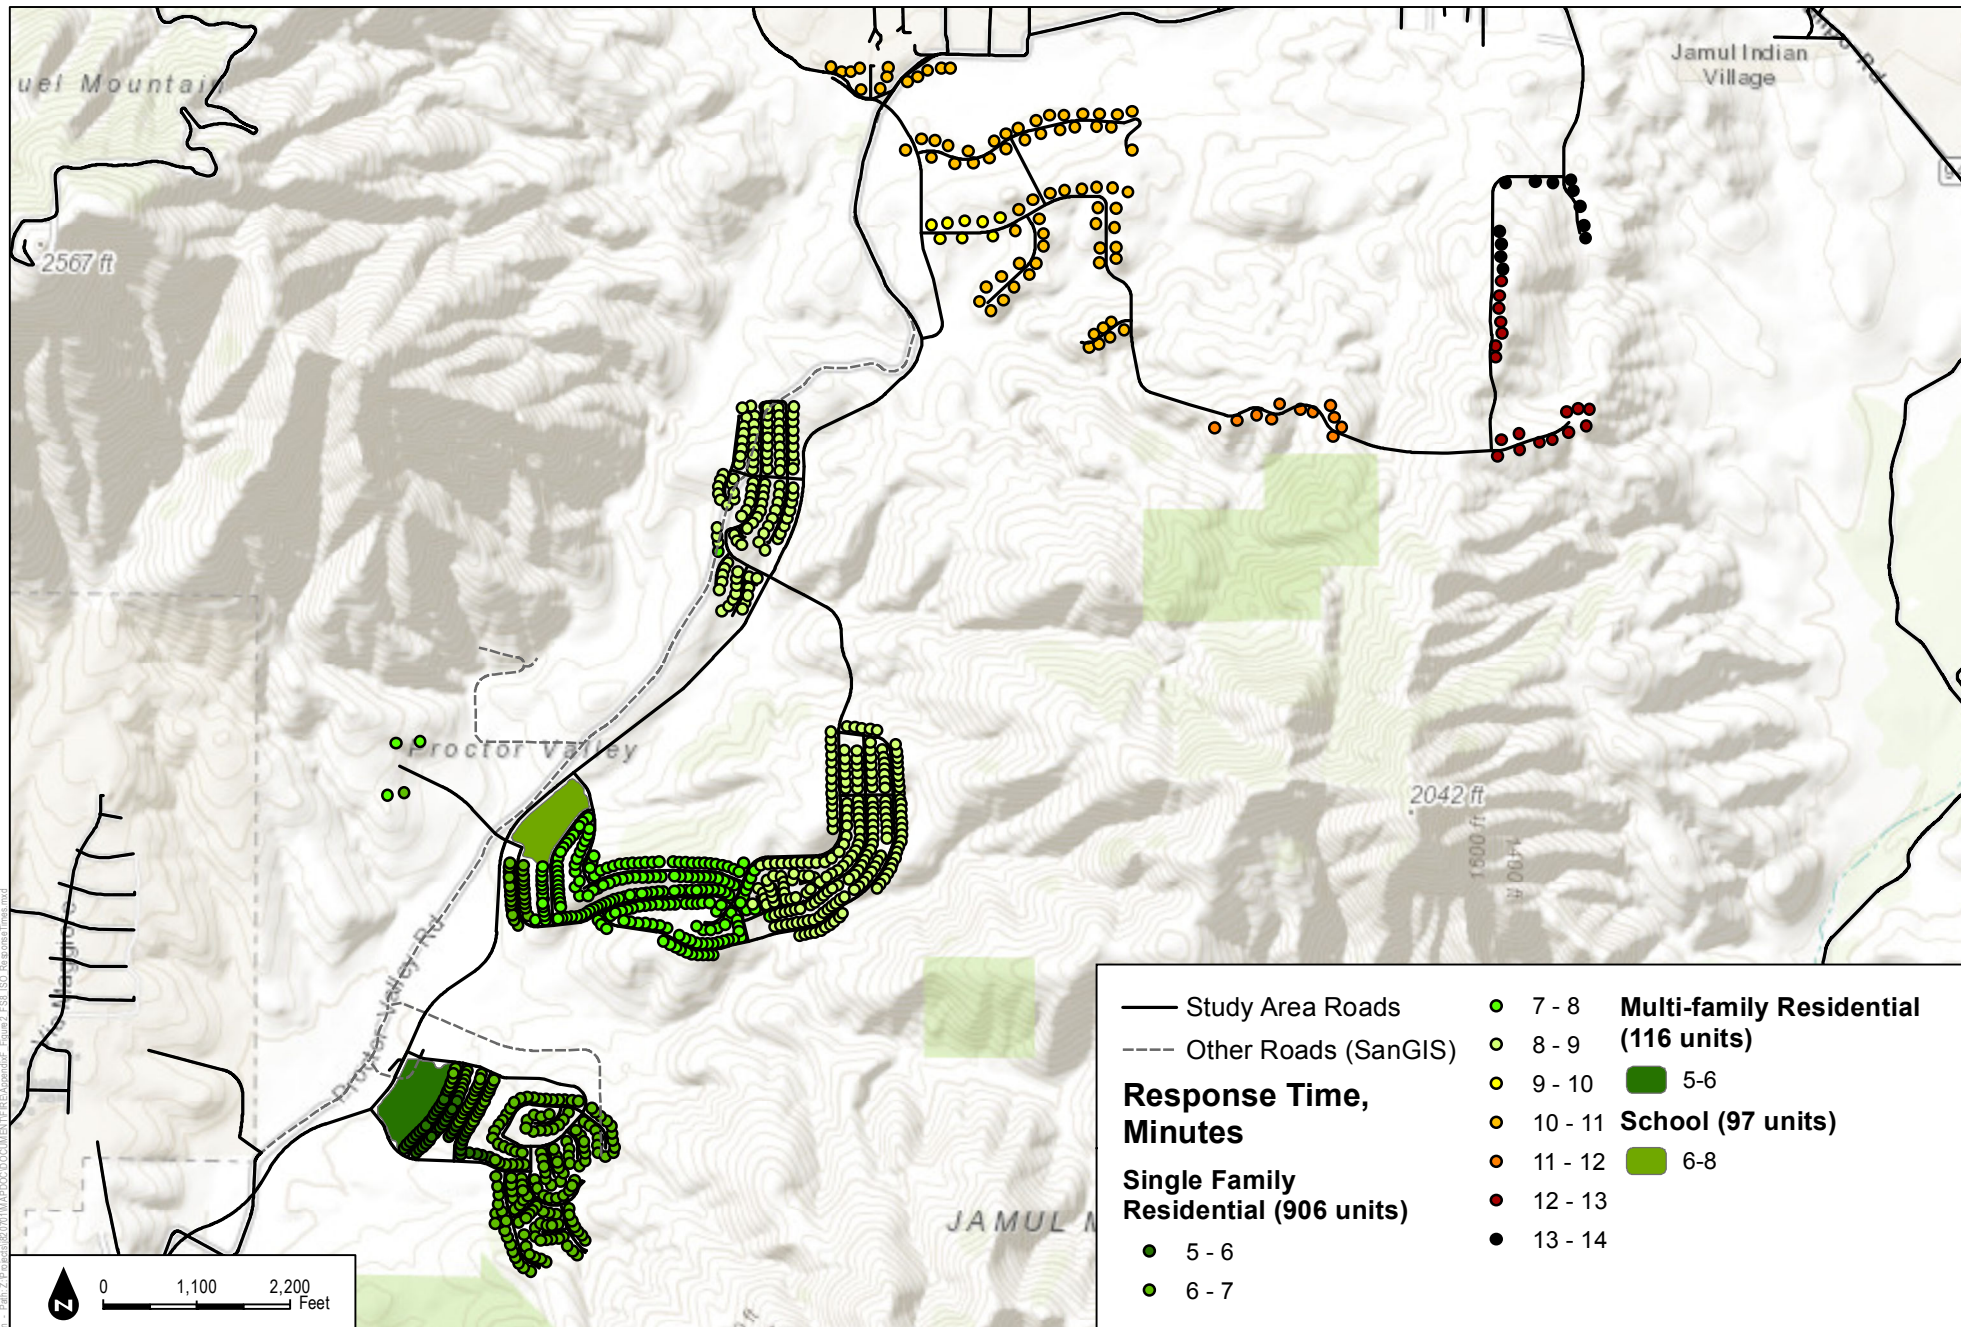


SOURCE: ESRI 2015; SANGIS 2015; Hunsaker 2015

Otay Ranch Village 14 and Planning Areas 16/19

APPENDIX F-2

Fire Station 8 - ISO Response Analysis

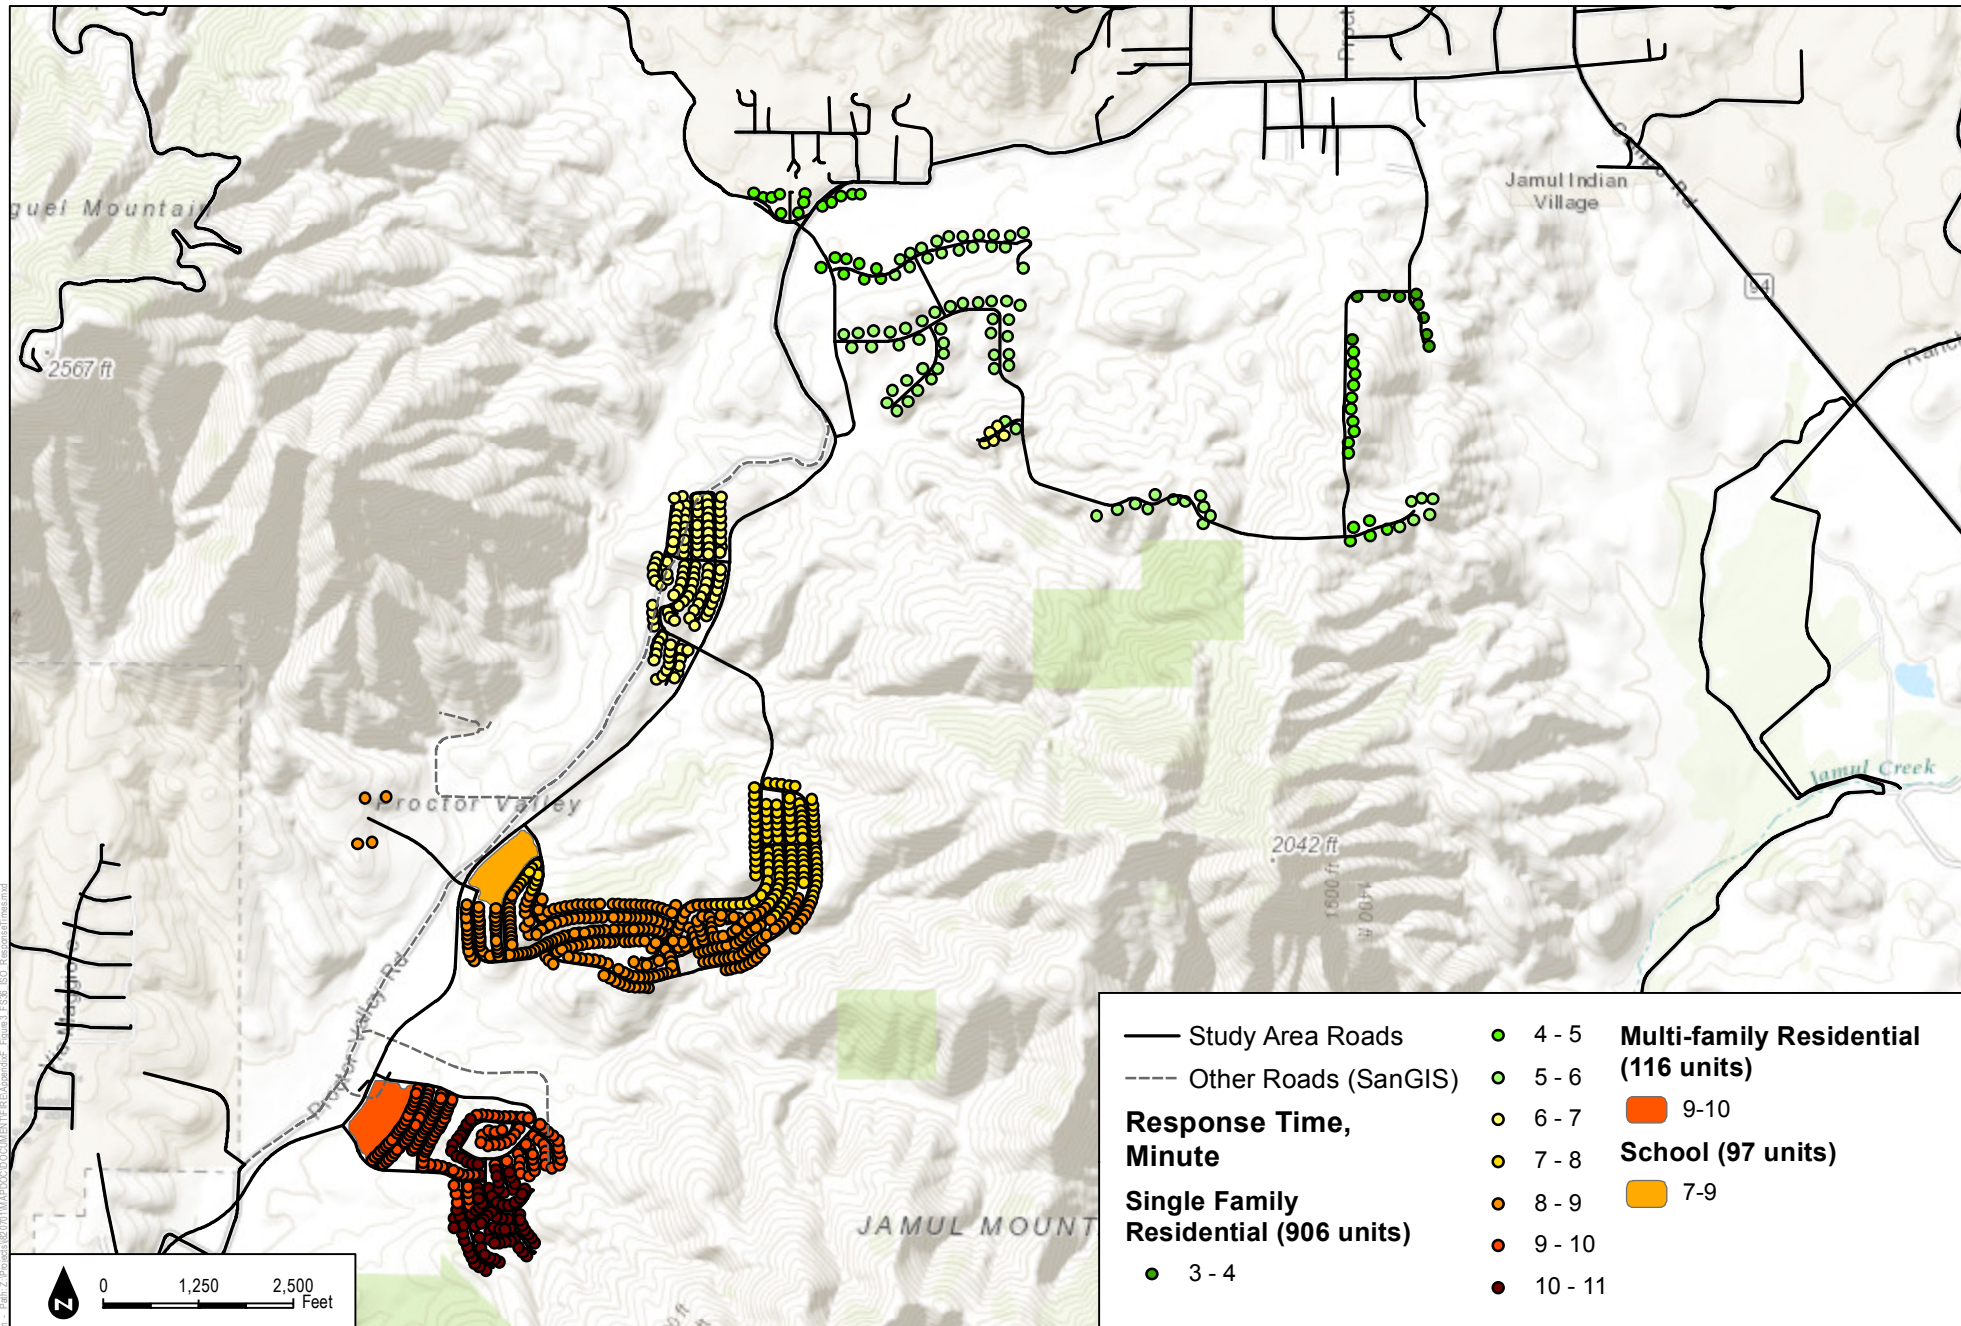


SOURCE: ESRI 2015; SANGIS 2015; Hunsaker 2015

DUDEK

Otay Ranch Village 14 and Planning Areas 16/19

APPENDIX F-3
Fire Station 36 - ISO Response Analysis

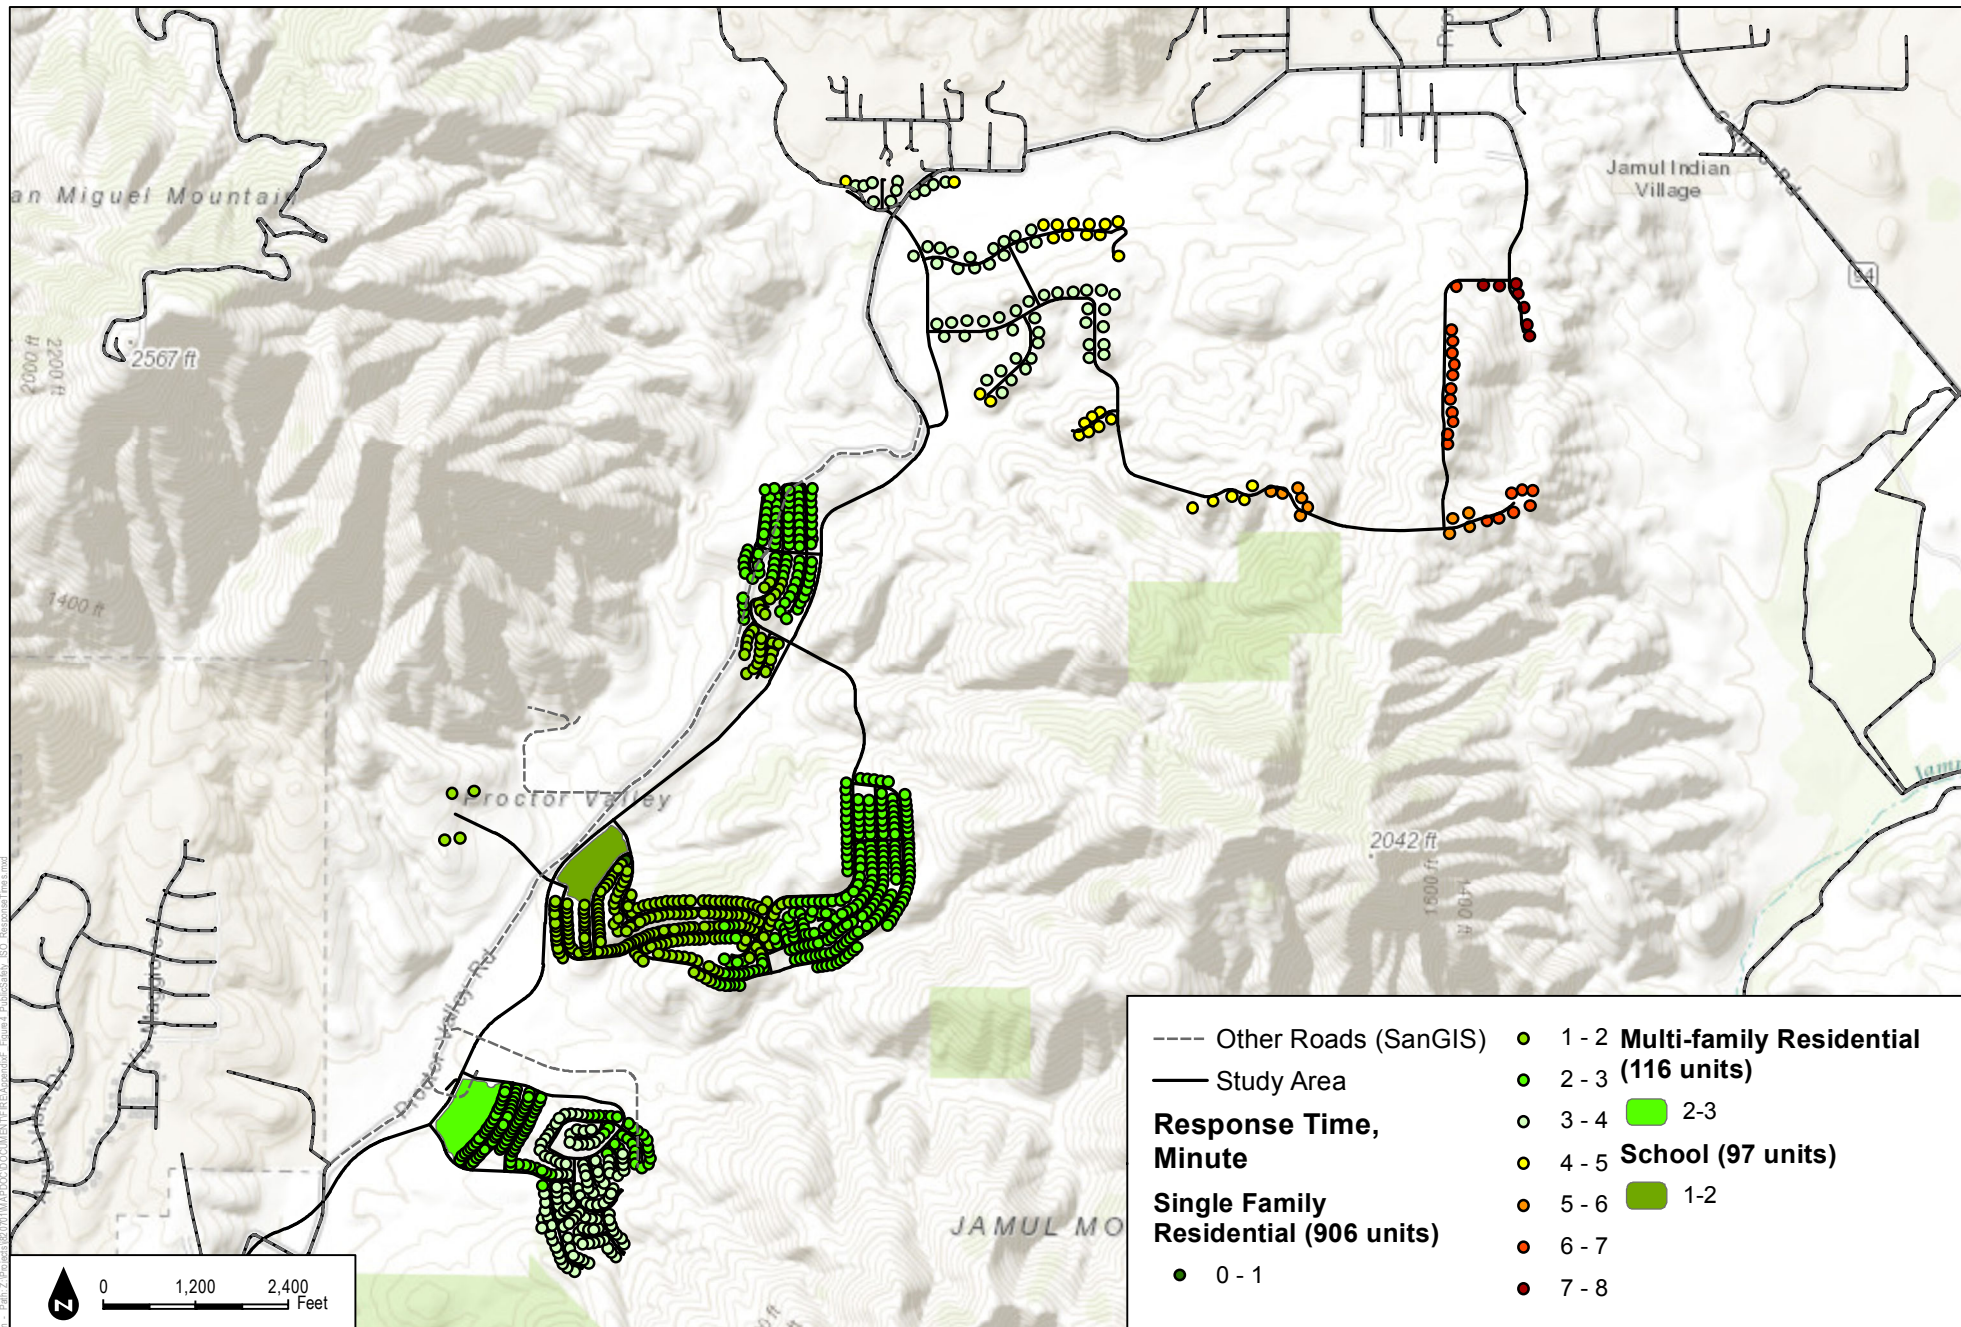

SOURCE: ESRI 2015; SANGIS 2015; Hunsaker 2015

Otay Ranch Village 14 and Planning Areas 16/19

APPENDIX F-4

Proposed Public Safety Site - ISO Response Analysis