

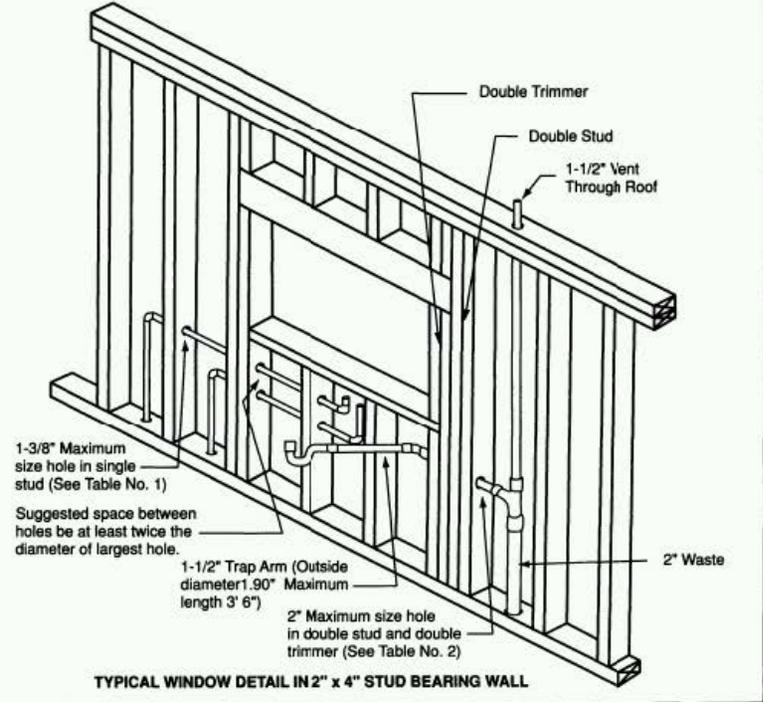


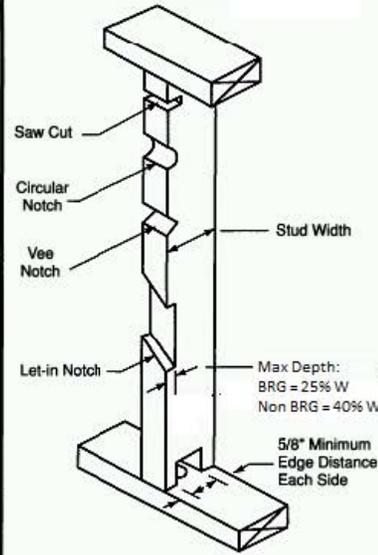

County of San Diego, Planning & Development Services
CUTTING NOTCHING AND BORING OF FLOOR JOISTS
BUILDING DIVISION

This sheet portrays the requirements regarding cutting, notching and boring of floor joists and studs contained in Section 502.8 of the 2016 CRC

A. CUTTING, NOTCHING & BORING OF WOOD FLOOR JOISTS

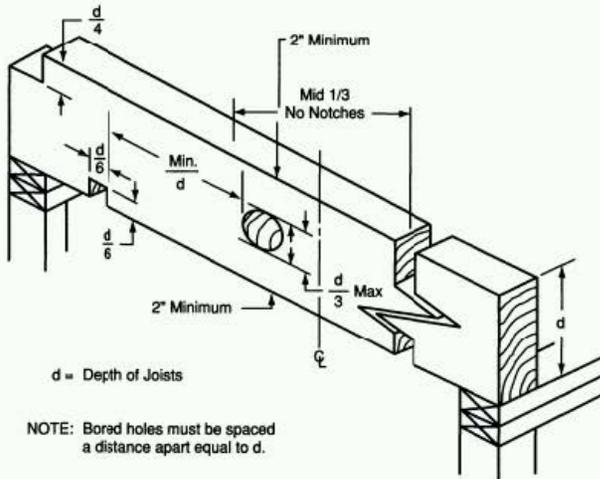

B. BORED HOLES IN WOOD STUDS (Based on Section 602.6 of CRC)

Bearing Walls
 Any wood stud may be bored not in excess of 40% of the stud width. Borings shall not be made at the same section of a stud where a cut or notch has been made.

Table No. 1	Stud Size	Max. Diameter of Bored Hole	Min. Edge Distance After Boring
	2" x 4"	1-3/8"	5/8" each side of hole
	2" x 6"	2-3/16"	5/8" each side of hole

Non Bearing Walls
 Studs may be bored not in excess of 60% of the stud width in either (1) non bearing stud walls, or (2) bearing walls where studs are doubled and not more than two such successive doubled studs are so bored. Borings shall not be made at the same section where a cut or notch has been made.

Table No. 2	Stud Size	Max. Diameter of Bored Hole	Min. Edge Distance After Boring
	2" x 3"	1-1/4" *	5/8" each side of hole
	2" x 4"	2"	5/8" each side of hole
	2" x 6"	3-1/4"	5/8" each side of hole



C. CUTTING AND NOTCHING WOOD STUDS (Based on Section 602.6 of CRC)

Bearing Walls

Table No. 3	Stud Size	Max. Depth of Edge Cut or Notch	Min. Wood Width Remaining After Cut or Notch
	2" x 4"	7/8"	2-5/8"
	2" x 6"	1-3/8"	4-1/8"

Non Bearing Walls

Table No. 4	Stud Size	Max. Depth of Edge Cut or Notch	Min. Wood Width Remaining After Cut or Notch
	2" x 3"	1"	1-1/2"
	2" x 4"	1-3/8"	2-1/8"
	2" x 6"	2-1/8"	3-3/8"

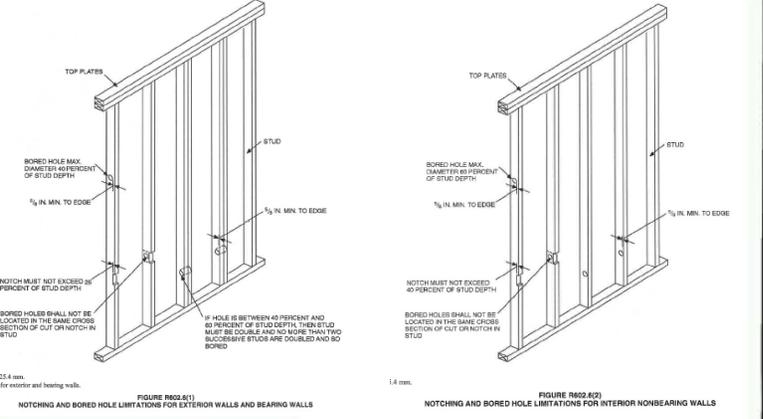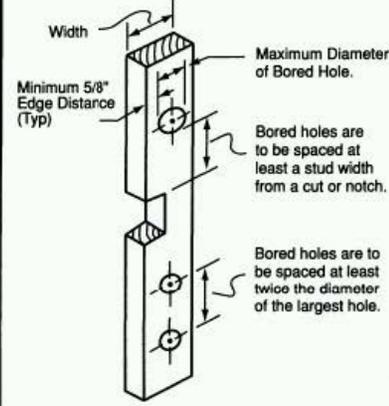

5510 OVERLAND AVE, SUITE 110, SAN DIEGO, CA 92123 • (858) 565-5920 • (888) 336-7553

[HTTP://WWW.SDCPS.ORG](http://www.sdcps.org)