



**County of San Diego  
Planning & Development Services  
BUILDING DIVISION**

ACCESSIBILITY CORRECTION LIST

Multifamily Housing

**12A**

**Public Telephones**

RECORD ID:

OWNER ON APPLICATION:

**SCOPING**

1. Public telephones provided in common-use spaces shall be accessible per the following:
  - On floors where public telephones are provided, at least one accessible telephone required
  - On floors where two or more banks of multiple telephones provided, at least one accessible telephone required in each bank

*CBC 1140A.1*

**VOLUME-CONTROL TELEPHONES**

2. Where public telephones are provided in common-use areas, identify at least one telephone equipped with volume control on each floor or in each bank, whichever is more.
 

*CBC 1140A.6*
3. Specify volume-control telephones complying with the following:
  - Receiver generating magnetic field in area of receiver cap
  - Hearing-aid compatible
  - Capable of providing a gain adjustable up to minimum 20 decibels
  - For incremental volume control, at least one intermediate step of minimum 12 decibels gain
  - Includes automatic reset
  - Identified by signage per CBC Figure 11A-11D



**FIGURE 11A-11D  
VOLUME CONTROL TELEPHONES**

*CBC 1140A.6*

**THIS DOCUMENT IS FOR PLAN REVIEW ONLY.  
CORRECTION LIST ITEMS AND FIGURES MAY NOT BE REPRODUCED OR COPIED ON PLANS.  
IF CONFLICTS EXIST BETWEEN CODE TEXT AND FIGURES, THE CODE TEXT SHALL GOVERN.**

**5510 OVERLAND AVE, SUITE 110, SAN DIEGO, CA 92123 • (858) 565-5920 • (888) 336-7553**

**HTTP://WWW.SDCPDS.ORG**

## TEXT TELEPHONES (TTY)

4. If a total of four or more public telephones are provided at the interior and exterior of a site – with at least one at an interior location – specify at least one interior phone as a text telephone (TTY) complying with the following:
- Permanently affixed within or adjacent to telephone enclosure
  - Equipped with a shelf and electrical outlet within or adjacent to telephone enclosure
  - Telephone handset capable of being placed flush on shelf surface
  - Shelf capable of accommodating TTY with minimum 6 inches vertical clearance above area where TTY is to be placed
  - Minimum 29-inch-long cord from telephone to handset
  - Where an acoustic coupler is used, telephone cord shall be sufficiently long to allow connection of the TTY and the telephone receiver
  - Touch surface of TTY keypads minimum 34 inches above finished floor
  - Push-button controls where service for such equipment is available
  - Any telephone books within CBC 1138A.3 reach ranges
  - Identified by signage per CBC Figure 11A-11C



FIGURE 11A-11C  
INTERNATIONAL TTY SYMBOL


CBC 1140A.7

## DIMENSIONS AND CLEARANCES

5. Dimension wheelchair clear floor/ground space complying with the following at each accessible telephone:
- Minimum 30 inches by 48 inches
  - Allowing forward or parallel approach
  - One full unobstructed side adjoining another wheelchair clear floor/ground space


CBC 1140A.2 and CBC 1140A.3

6. Dimension telephone mounting height and any enclosures per the following:
- Where only forward approach allowed, per CBC Figure 11A-11B(b)

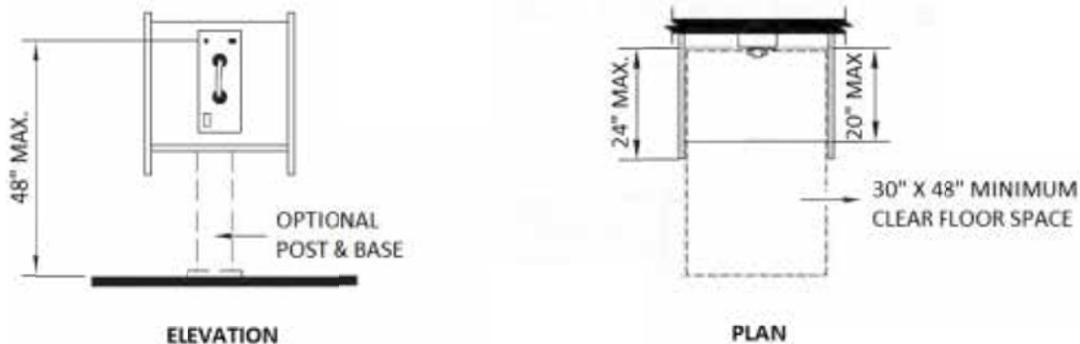

(b) FORWARD APPROACH  
FIGURE 11A-11B  
TELEPHONES

- Where parallel approach allowed, per CBC Figure 11A-11B(a)

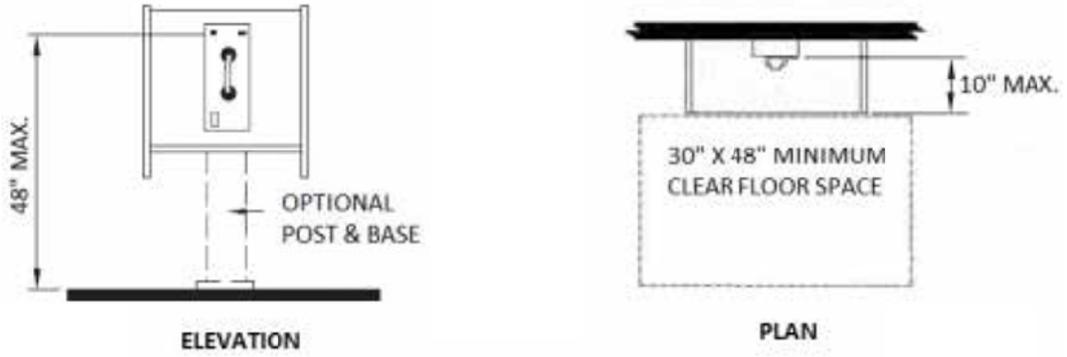

(a) PARALLEL APPROACH  
FIGURE 11A-11B  
TELEPHONES

CBC 1140A.4

- 7. Specify minimum 29-inch-long cord from phone to handset.

CBC 1140A.9

- 8. Specify push-button telephone controls where service available.

CBC 1140A.8